


# Project Need



## Reliability Concerns & Drivers

Transmission structures, line conductor, and static (shield) wires were installed in the 1960s and are at the end of useful life.

Rebuild is necessary to resolve contingency violations of the North American Reliability Corporation Reliability Standards.

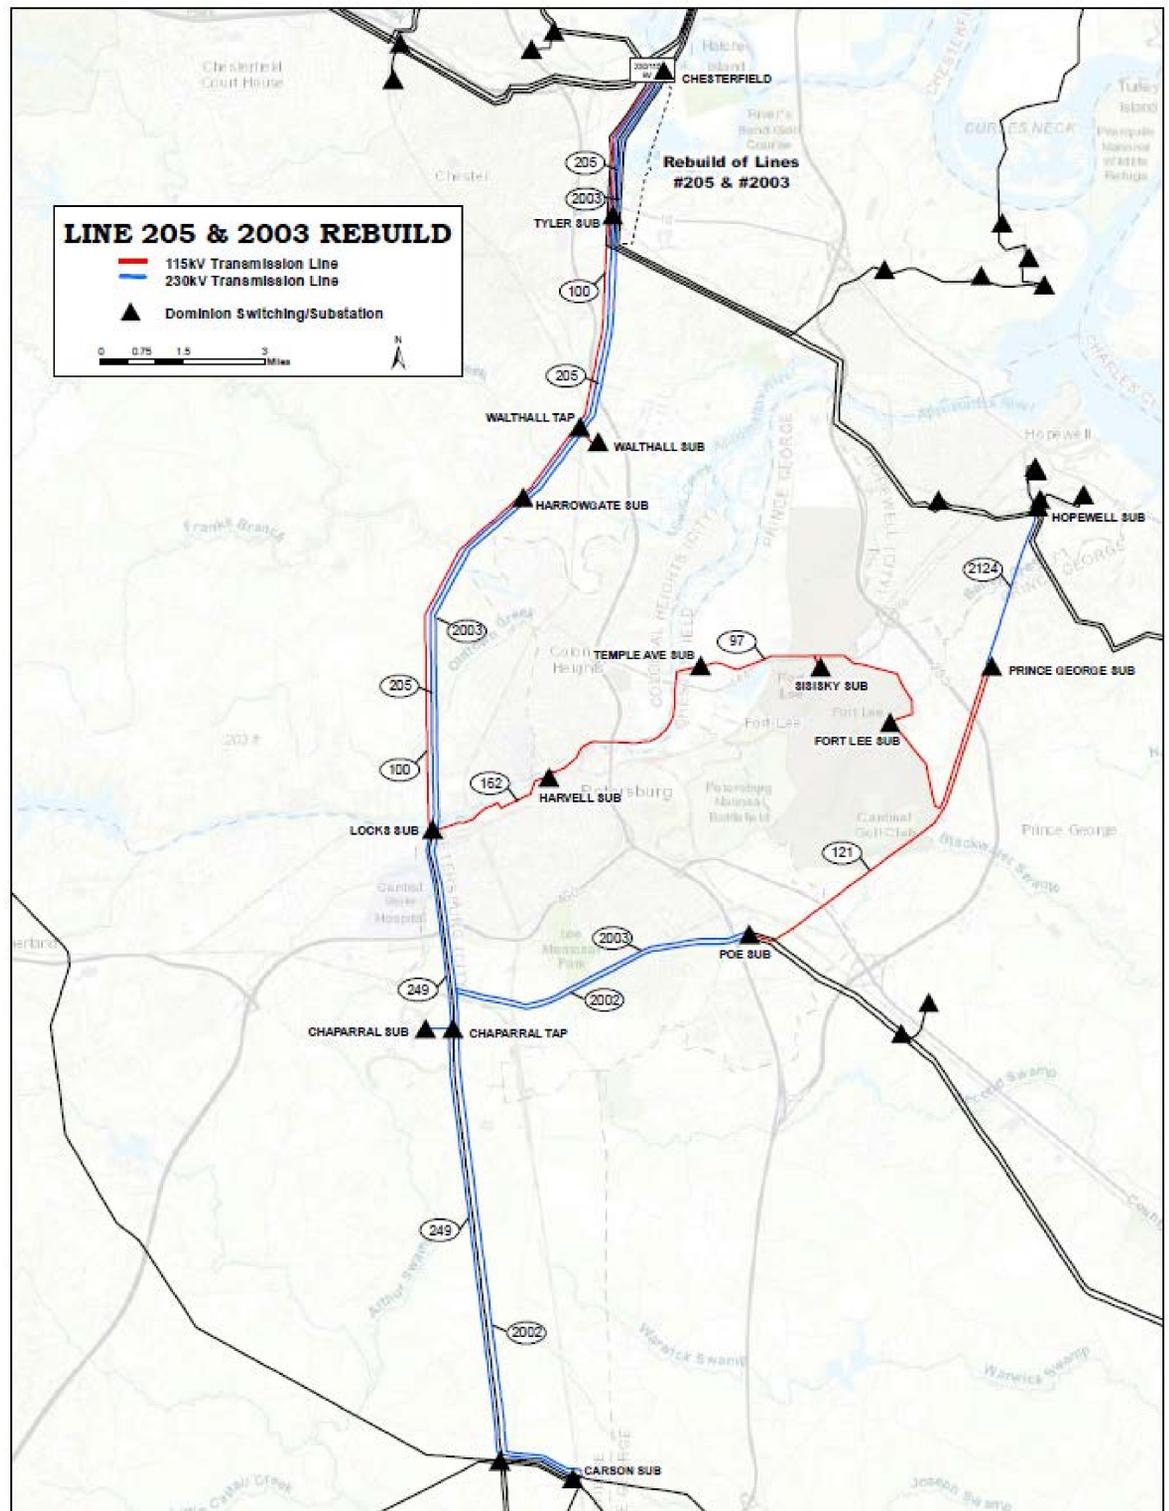

## Proposed Solution

In order to maintain structural integrity and reliability, Dominion Energy is proposing to rebuild the existing transmission lines and replace fiber.

- Constructed entirely within existing right of way
- Rebuilding to current industry standards
- Target completion date: **December 2022**