


Routes & Alternative Solutions Studied & Rejected

Nokesville to Bristow 230 kV Electric Transmission Project

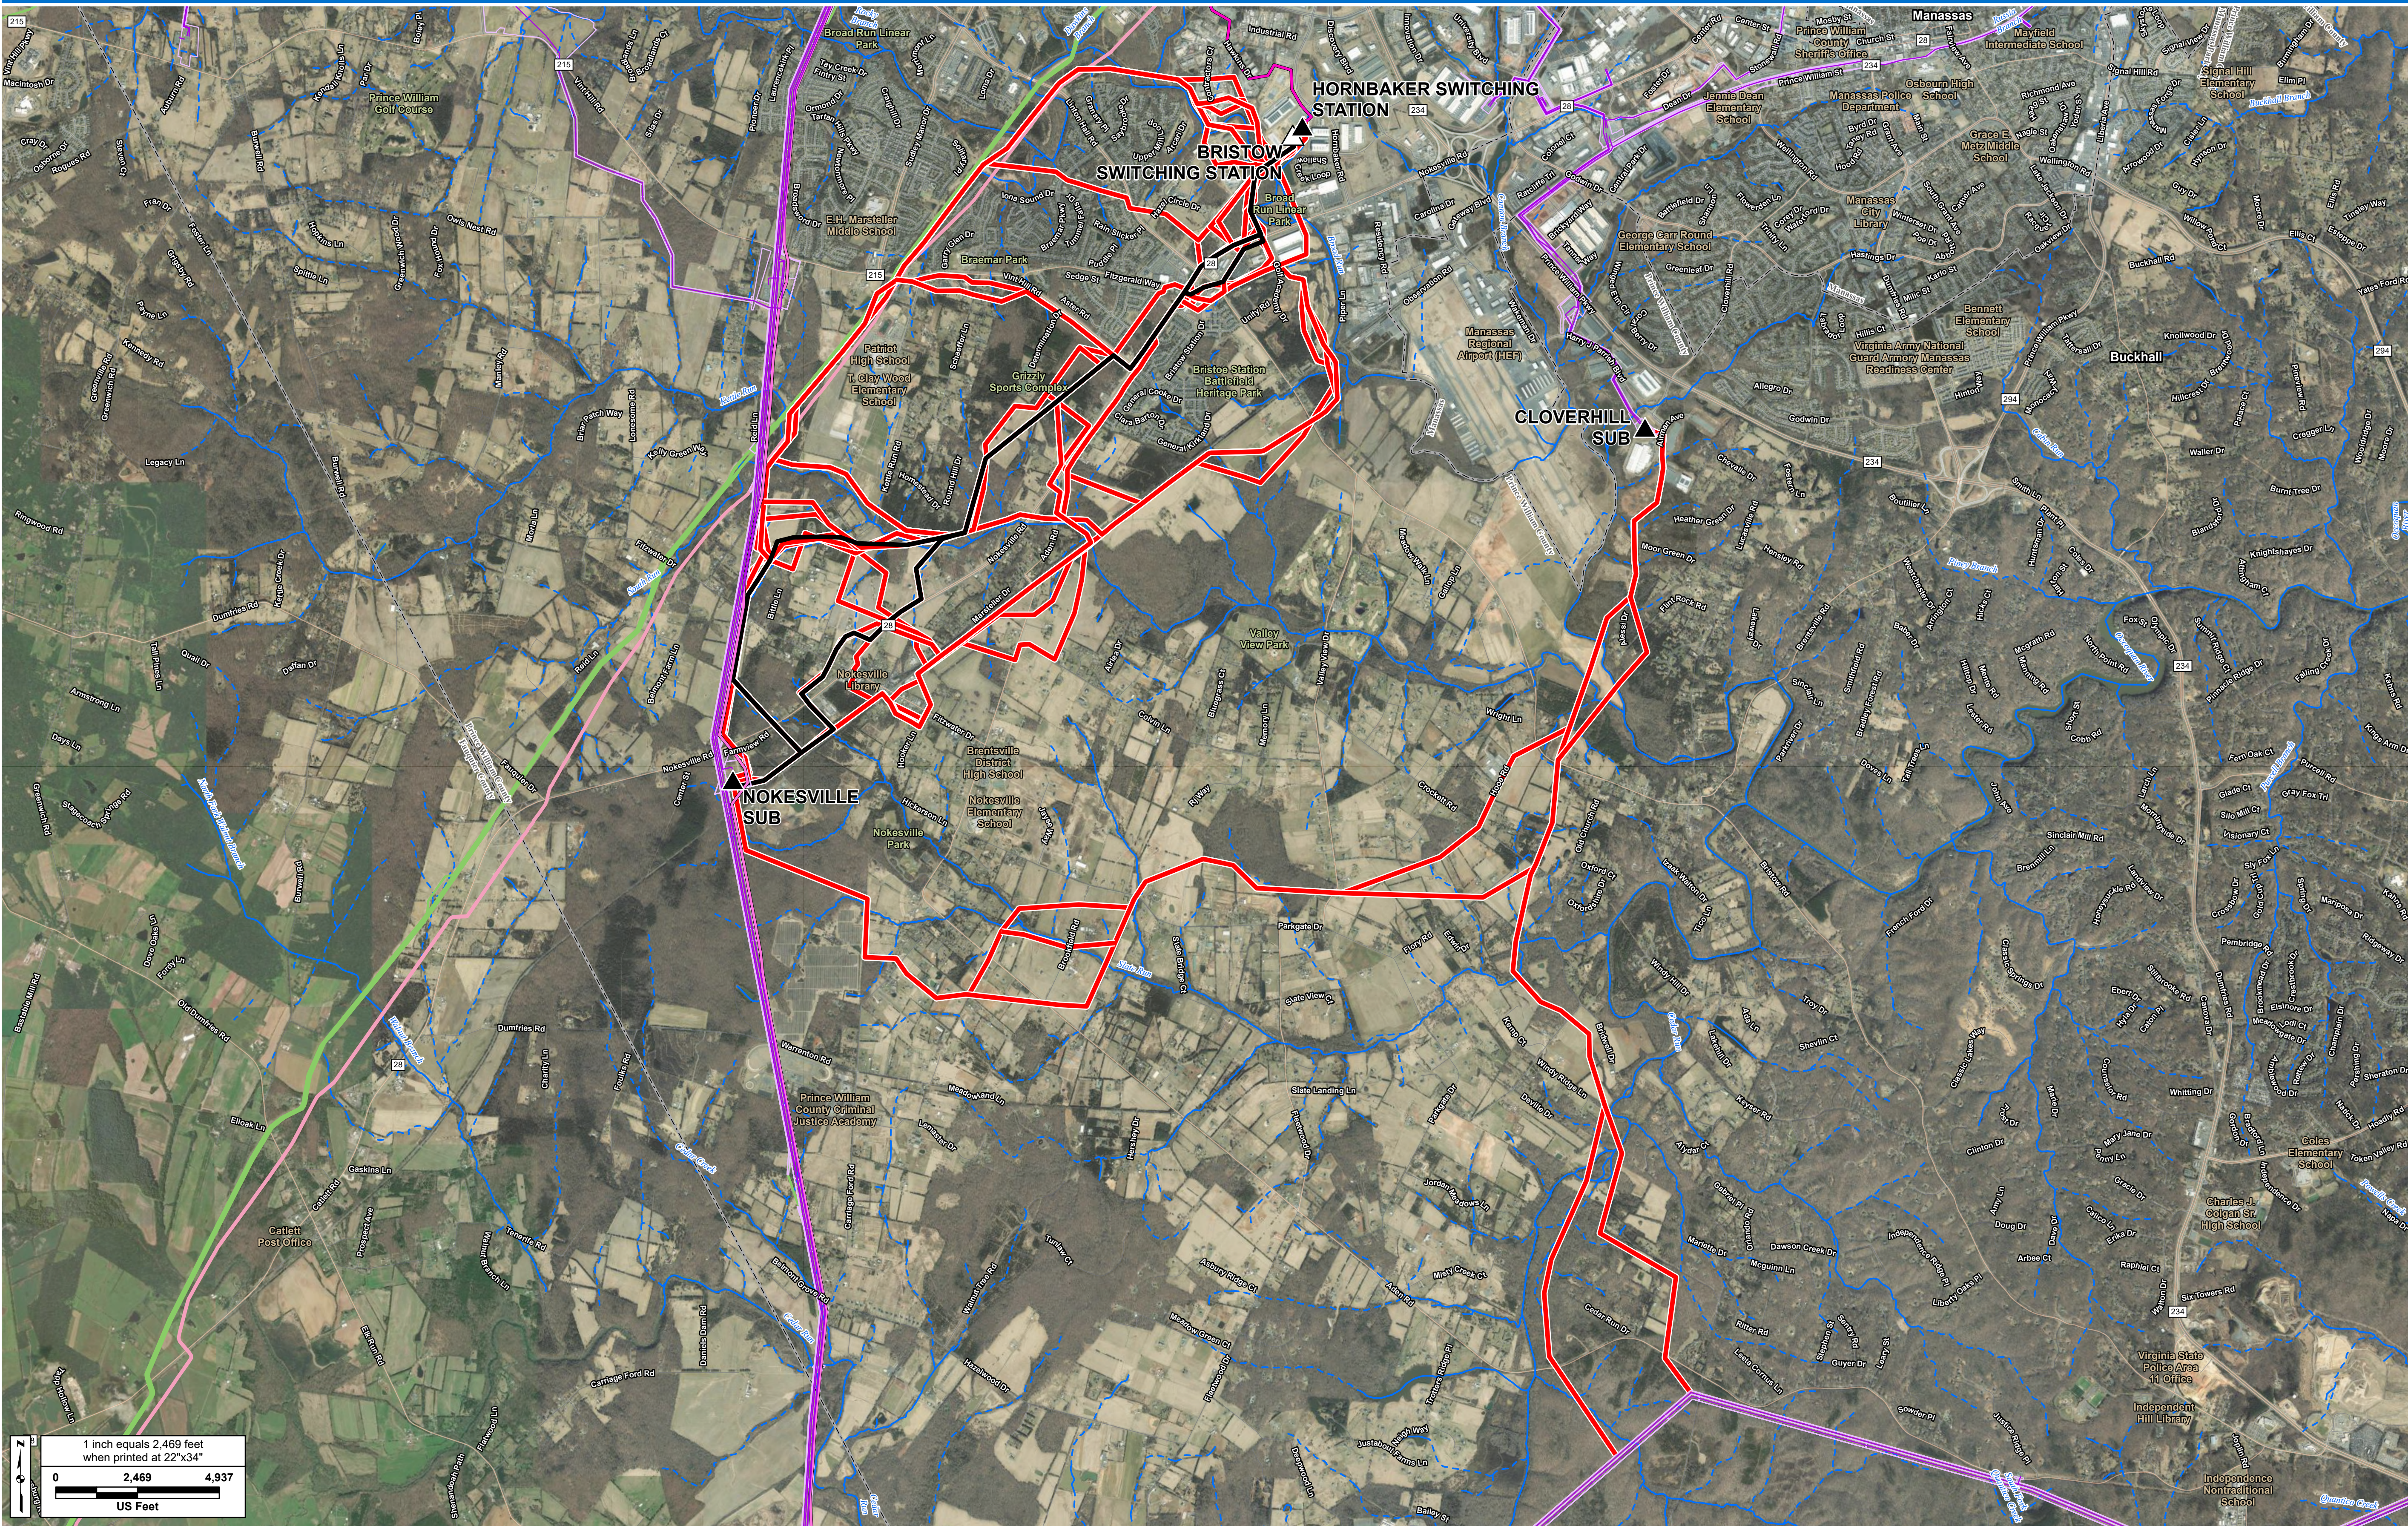

Dominion Facilities

- ▲ Dominion Substation/ Switching Station
- Existing Dominion Transmission Lines
- Existing Dominion Transmission Right of Way
- SCC Approved Devlin-Hornbaker Route
- SCC Proposed Morrisville-Wishing Star Route

Project Components

- △ Proposed Substation/ Switching Station
- Current Route Alternative
- Rejected Route

Constraints

- Natural Gas Pipeline
- Products Pipeline
- Stream/River: Perennial
- Stream/River: Intermittent

