

Preliminary Information for Review Purposes Only:
Route Alternatives as of July 07, 2022




South Hill
230 kV Project

Dominion Energy Virginia


Current Transmission
Route Alternatives

- Heritage Solution, Route Alternative 1
- Heritage Solution, Route Alternative 2
- Unity Solution, Route Alternative 1
- Unity Solution, Route Alternative 2
- Interconnect Corridor A Route 1
- Interconnect Corridor B Route 1
- Interconnect Corridor C Route 1
- Interconnect Corridor C Route 2
- Interconnect Corridor D Route 1
- Interconnect Corridor D Route 2
- Interconnect Corridor D Route 3
- Interconnect Corridor D Route 4
- Existing Dominion Transmission Line
- State Owned Land
- County Owned Land
- City Owned Land
- VA DOF Easement
- VOF Easement
- Existing Dominion Substation
- Proposed Dominion Substation

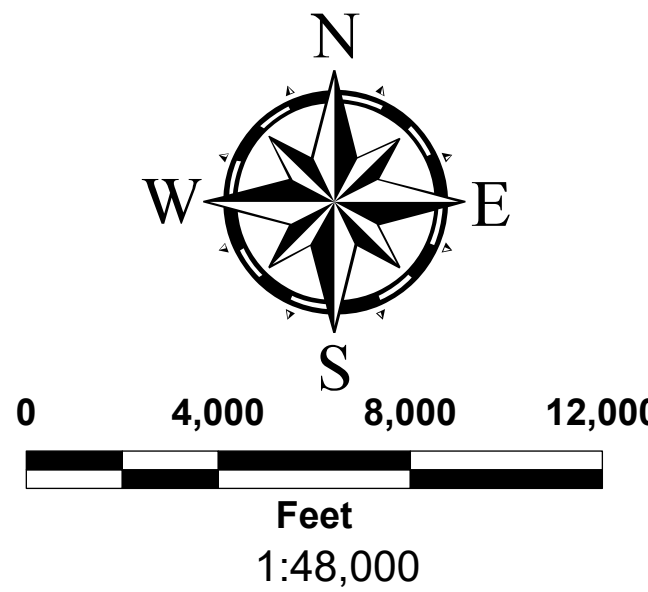


REVISION: 07/07/2022

DRAWN BY: MSP GIS

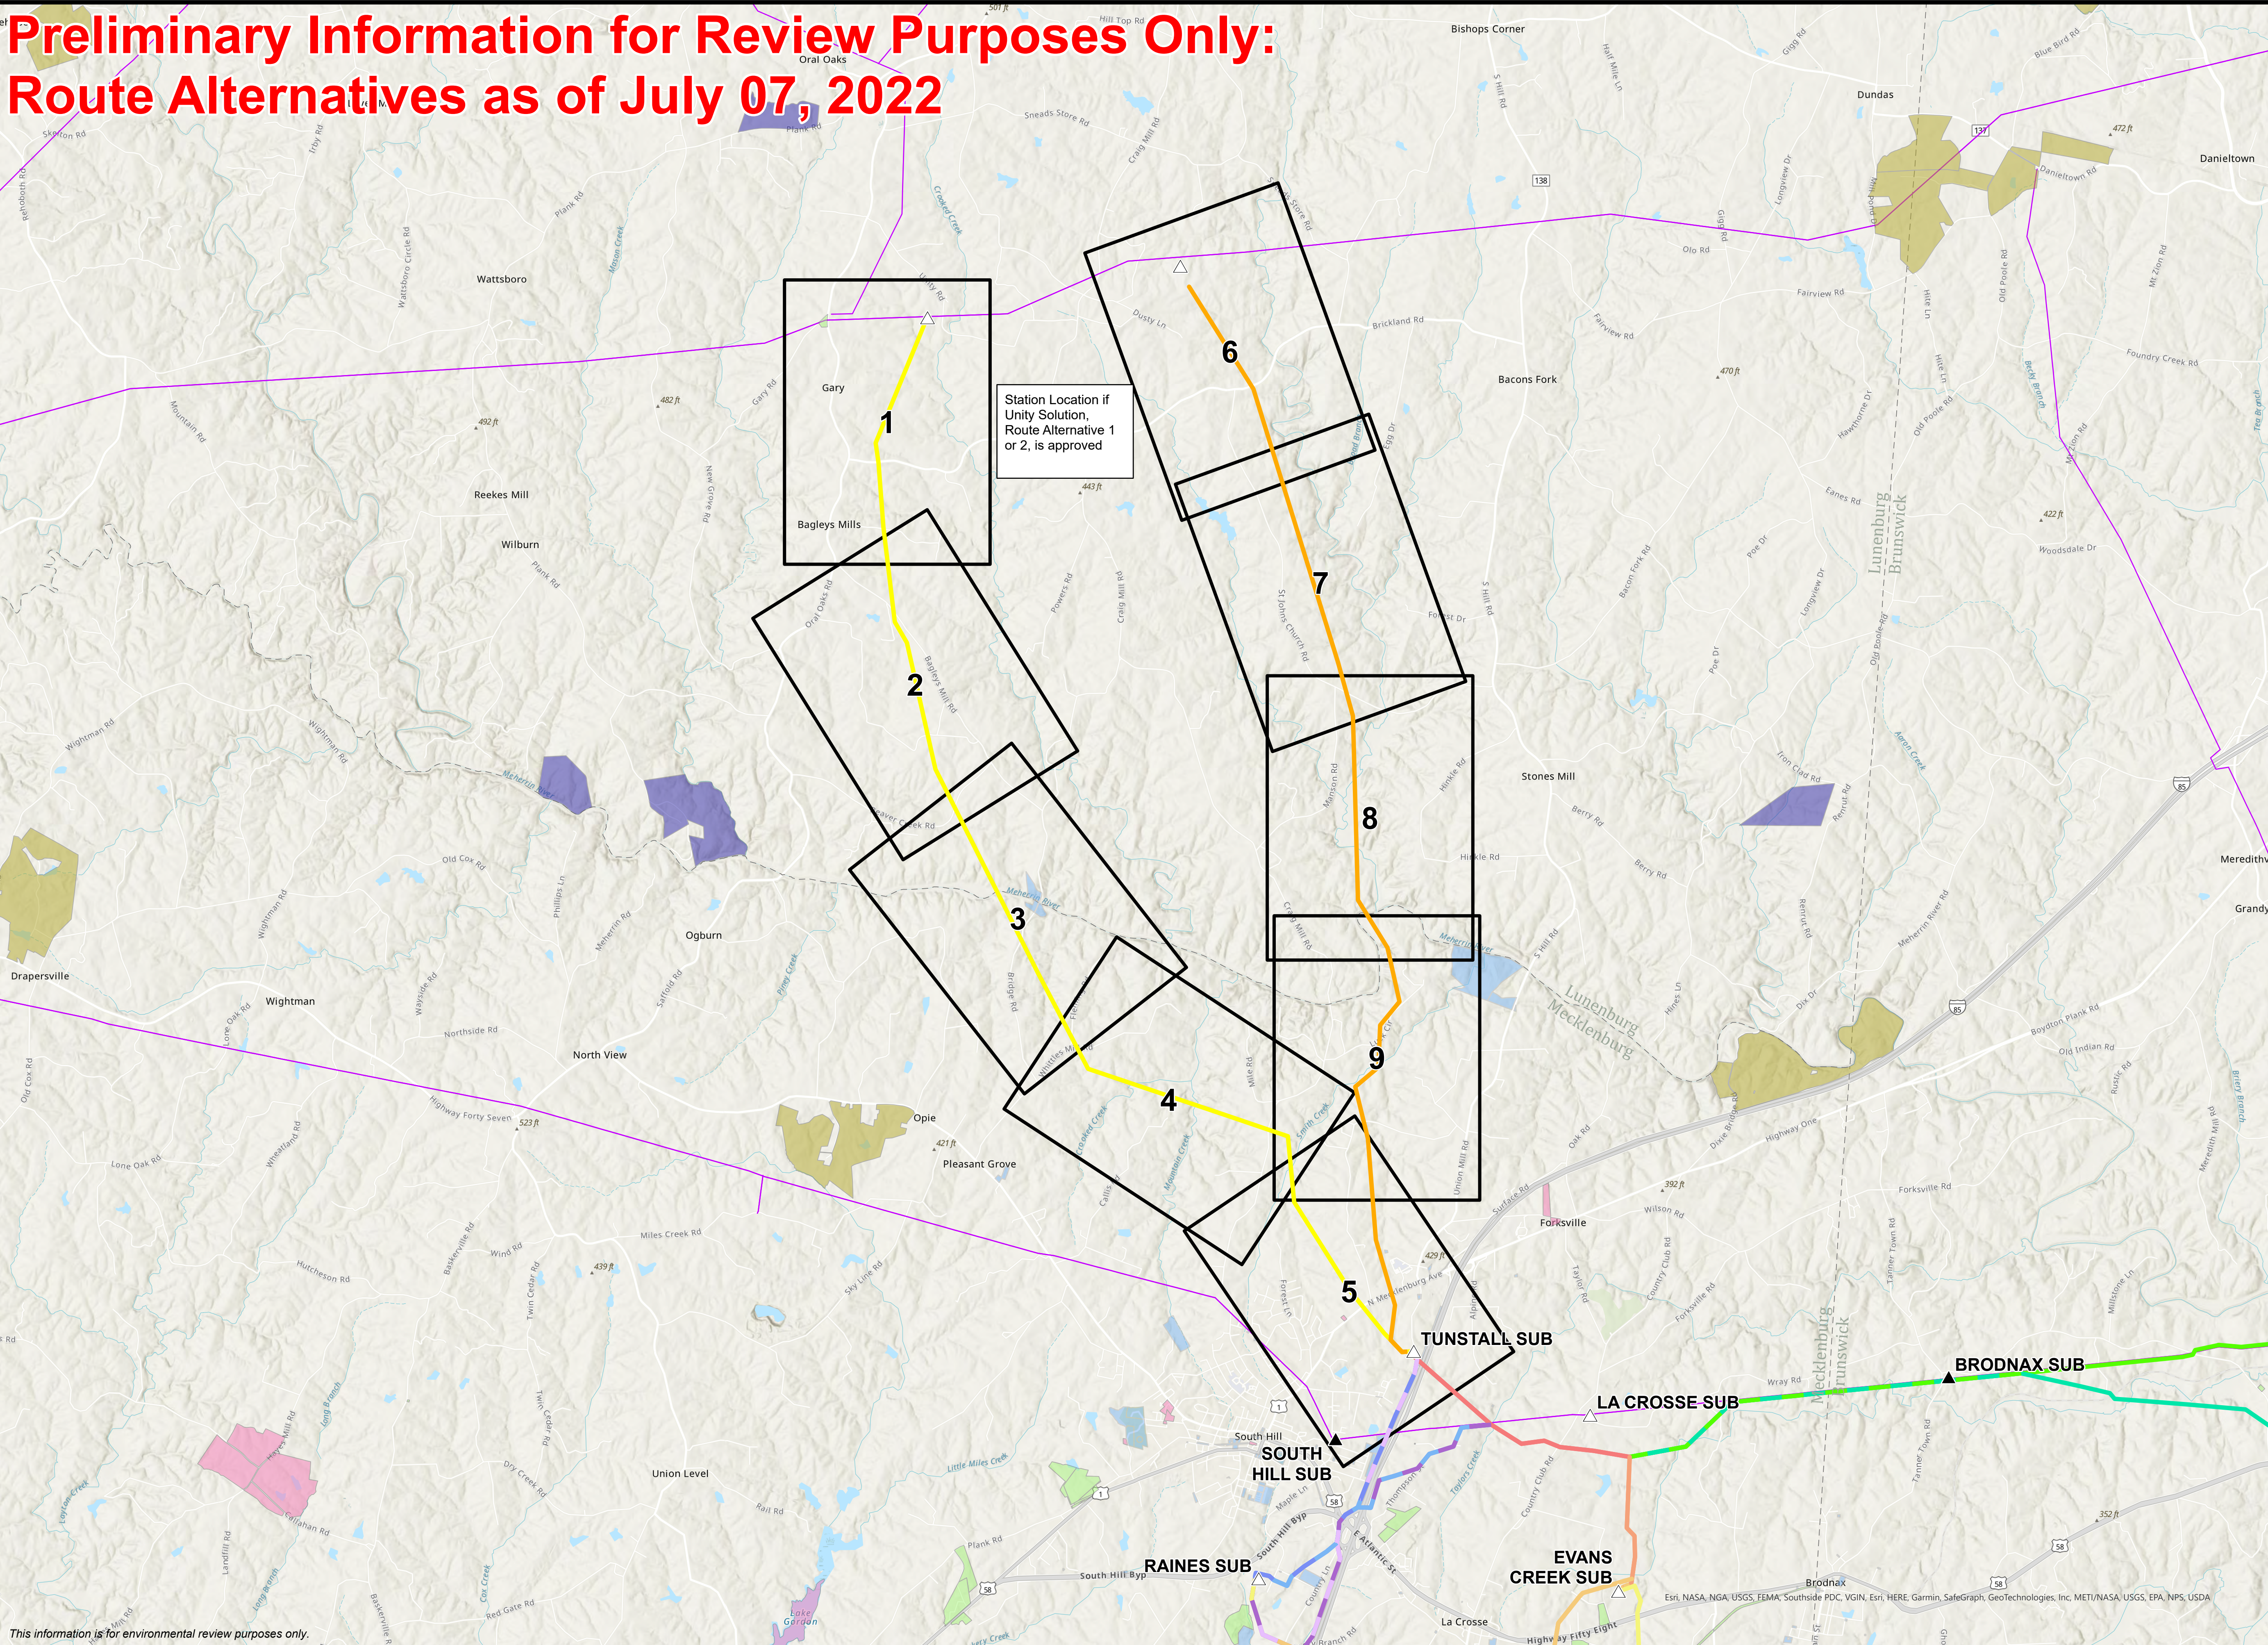

This information is for environmental review purposes only.

**Preliminary Information for Review Purposes Only:
Route Alternatives as of July 07, 2022**




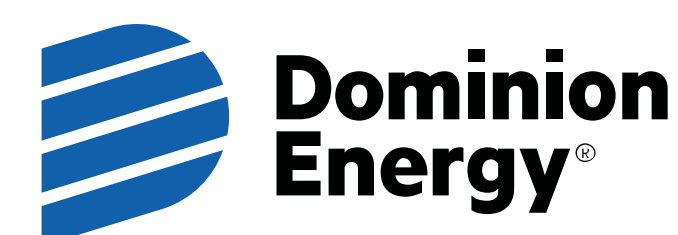


South Hill 230 kV Project

Dominion Energy Virginia

Current Transmission Route Alternatives

Page 1 of 9

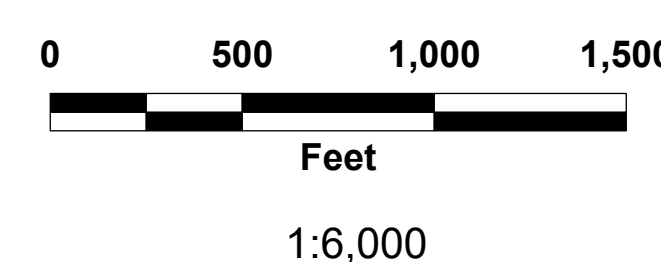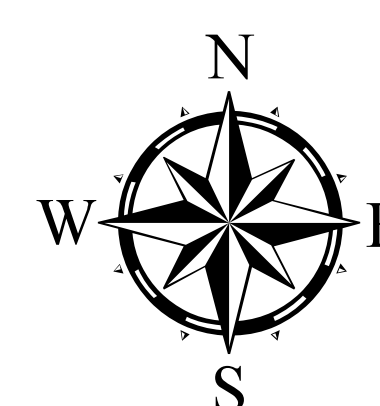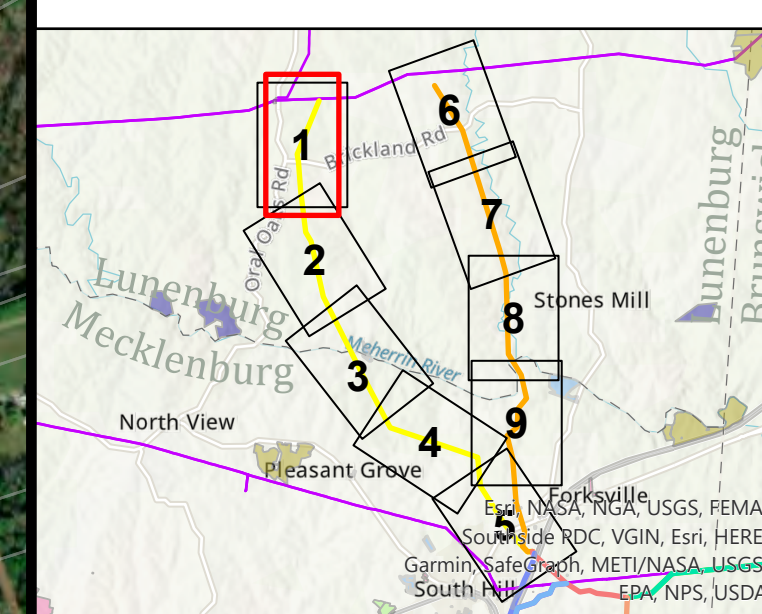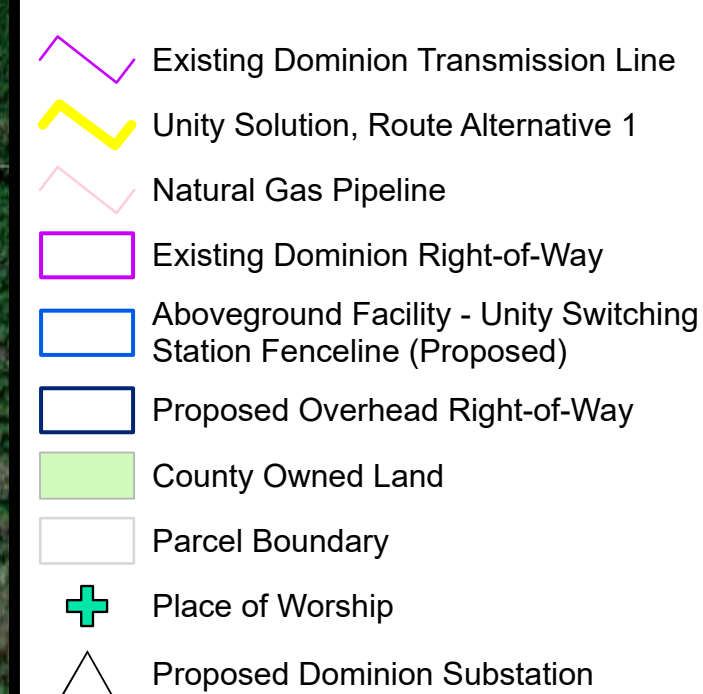

This information is for environmental review purposes only.

REVISÉ: 07/07/2022

DRAWN BY: MSP G

Preliminary Information for Review Purposes Only:
Route Alternatives as of July 07, 2022





South Hill
230 kV Project

Dominion Energy Virginia

Current Transmission
Route Alternatives

- Unity Solution, Route Alternative 1
- Natural Gas Pipeline
- Proposed Overhead Right-of-Way
- Parcel Boundary

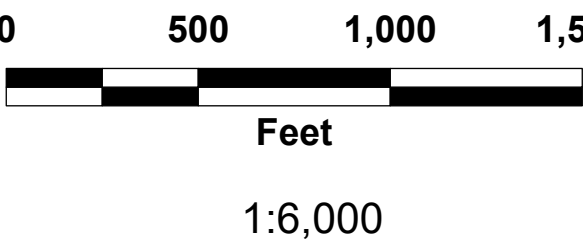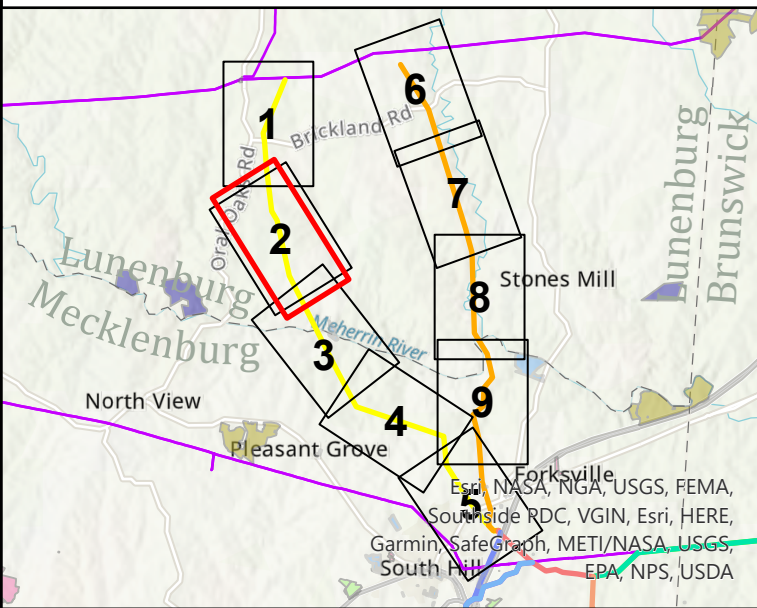

Preliminary Information for Review Purposes Only: Route Alternatives as of July 07, 2022





South Hill 230 kV Project

Dominion Energy Virginia

Current Transmission
Route Alternatives

Page 3 of 9

- Unity Solution, Route Alternative 1
- Natural Gas Pipeline
- Proposed Overhead Right-of-Way
- City Owned Land
- Parcel Boundary
- School

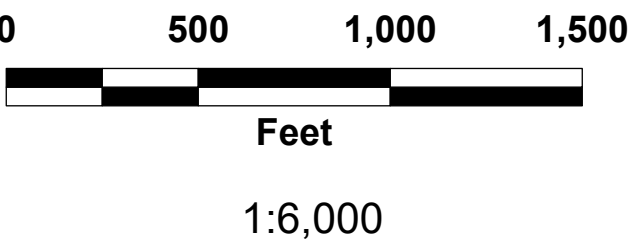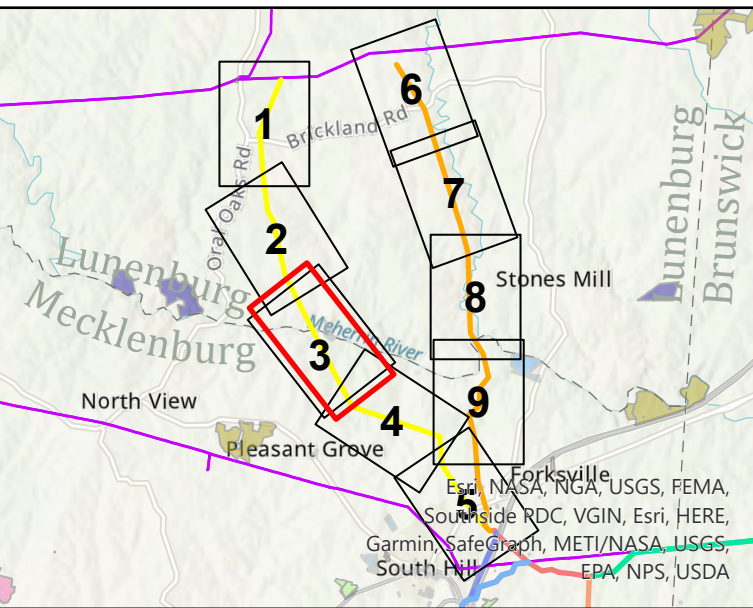

**Preliminary Information for Review Purposes Only:
Route Alternatives as of July 07, 2022**






South Hill 230 kV Project

Dominion Energy Virginia

Current Transmission Route Alternatives

Page 4 of 9

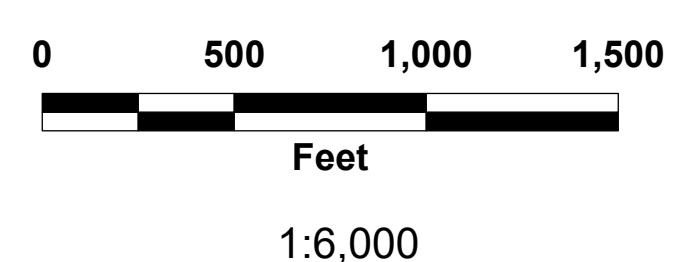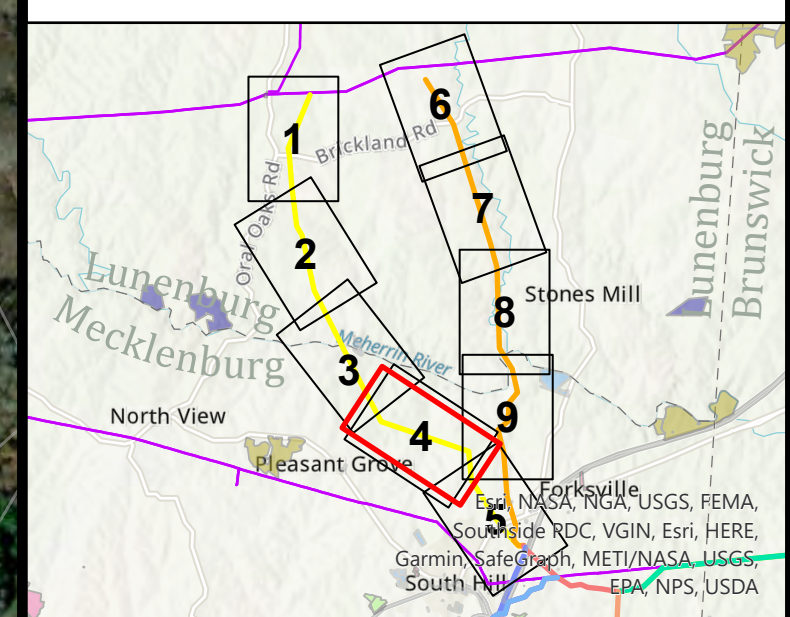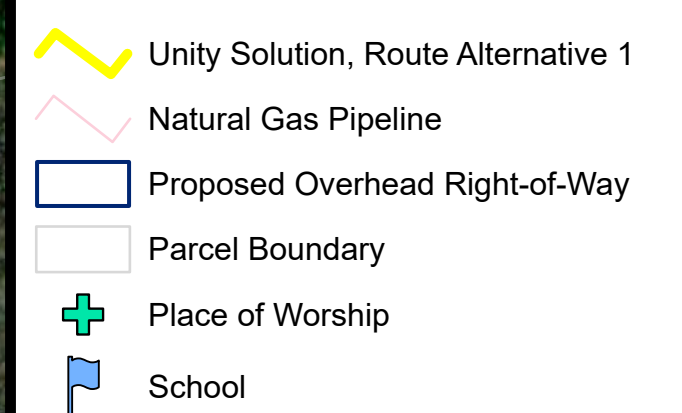

REVISÉ: 07/07/2022

DRAWN BY: MSP GIS

This information is for environmental review purposes only.

Preliminary Information for Review Purposes Only:
Route Alternatives as of July 07, 2022





South Hill
230 kV Project

Dominion Energy Virginia

Current Transmission
Route Alternatives

- Existing Dominion Transmission Line
- Unity Solution, Route Alternative 1
- Unity Solution, Route Alternative 2
- Interconnect Corridor A Route 1
- Interconnect Corridor D Route 1
- Interconnect Corridor D Route 3
- Natural Gas Pipeline
- Existing Dominion Right-of-Way
- Existing Overhead Right-of-Way
- Proposed Overhead Right-of-Way
- State Owned Land
- City Owned Land
- Parcel Boundary
- Place of Worship
- School
- Proposed Dominion Substation

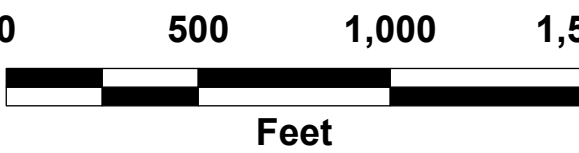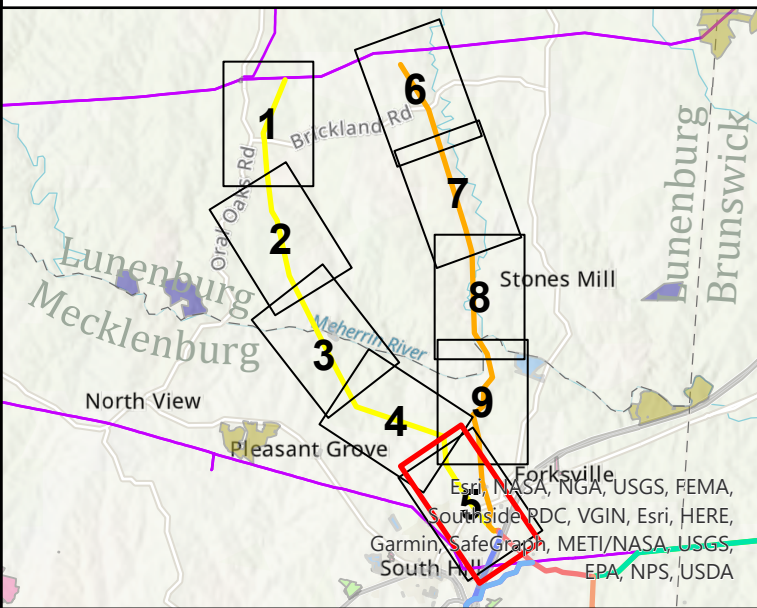

1:6,000



Preliminary Information for Review Purposes Only: Route Alternatives as of July 07, 2022






South Hill 230 kV Project

Dominion Energy Virginia

Current Transmission
Route Alternatives

- Existing Dominion Transmission Line
- Unity Solution, Route Alternative 2
- Existing Dominion Right-of-Way
- Aboveground Facility - Unity Switching Station Fenceline (Proposed)
- Proposed Overhead Right-of-Way
- Parcel Boundary
- Place of Worship
- Proposed Dominion Substation

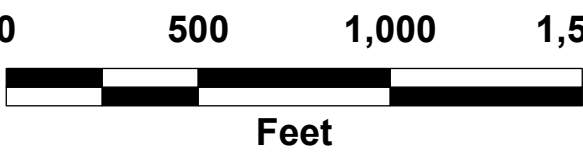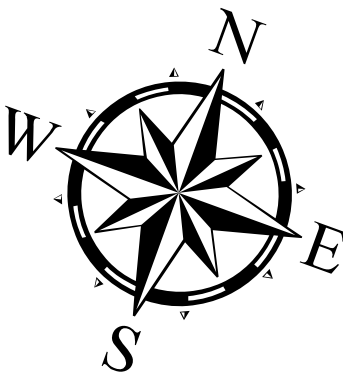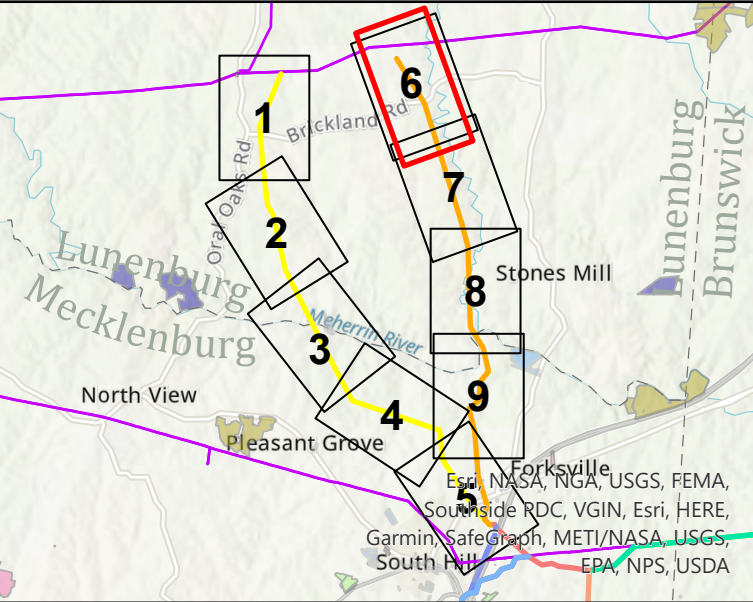

1:6,000



Preliminary Information for Review Purposes Only: Route Alternatives as of July 07, 2022






South Hill 230 kV Project

Dominion Energy Virginia

Current Transmission
Route Alternatives

Page 7 of 9

- Unity Solution, Route Alternative 2
- Proposed Overhead Right-of-Way
- Parcel Boundary

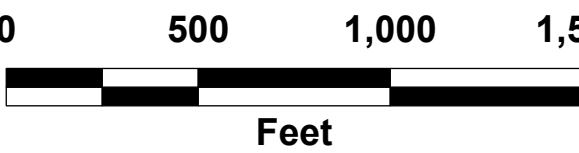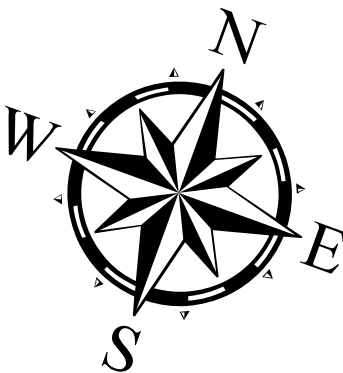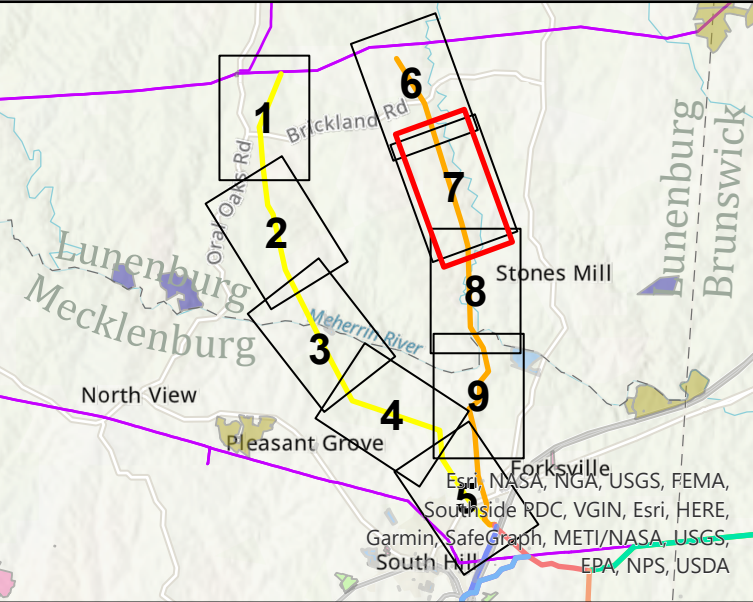

1:6,000



Preliminary Information for Review Purposes Only: Route Alternatives as of July 07, 2022






South Hill 230 kV Project

Dominion Energy Virginia

Current Transmission
Route Alternatives

Page 8 of 9

- Unity Solution, Route Alternative 2
- Proposed Overhead Right-of-Way
- City Owned Land
- Parcel Boundary

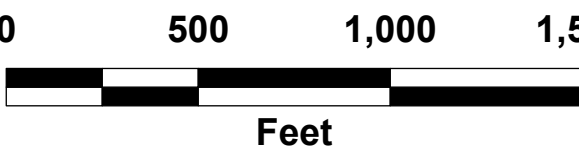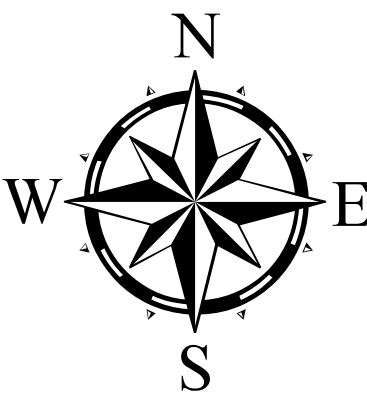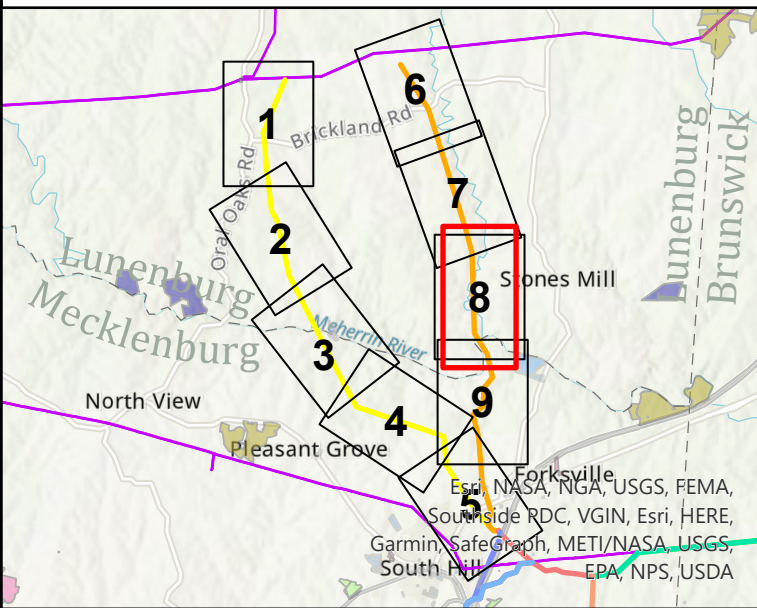

1:6,000



Preliminary Information for Review Purposes Only:
Route Alternatives as of July 07, 2022






South Hill
230 kV Project

Dominion Energy Virginia

Current Transmission
Route Alternatives

- Unity Solution, Route Alternative 1
- Unity Solution, Route Alternative 2
- Proposed Overhead Right-of-Way
- City Owned Land
- Parcel Boundary

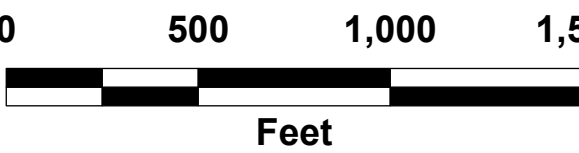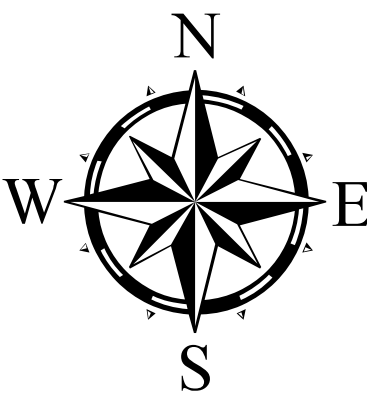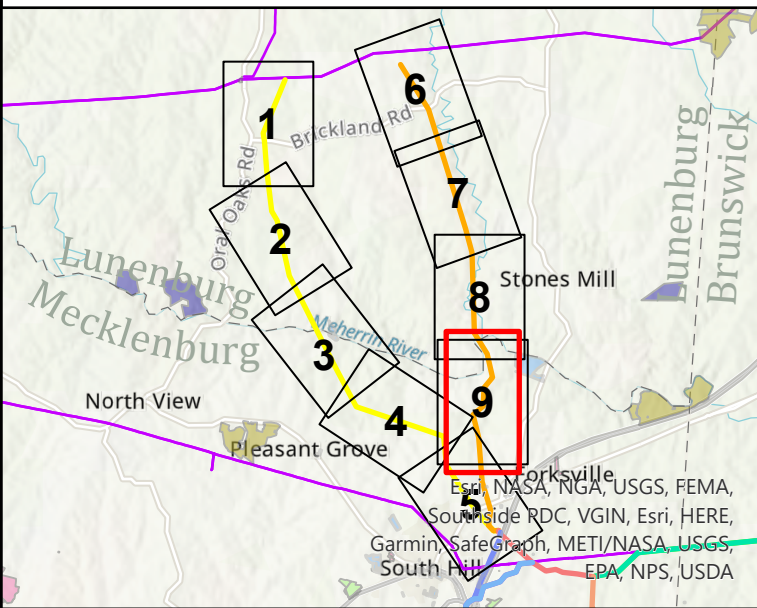

1:6,000

