


OFFSET/SELL- OFFSET ONLY PROGRAM WIRING DIAGRAM

BY KEA

DATE 08/23/2021

REV. 3

19.06-03

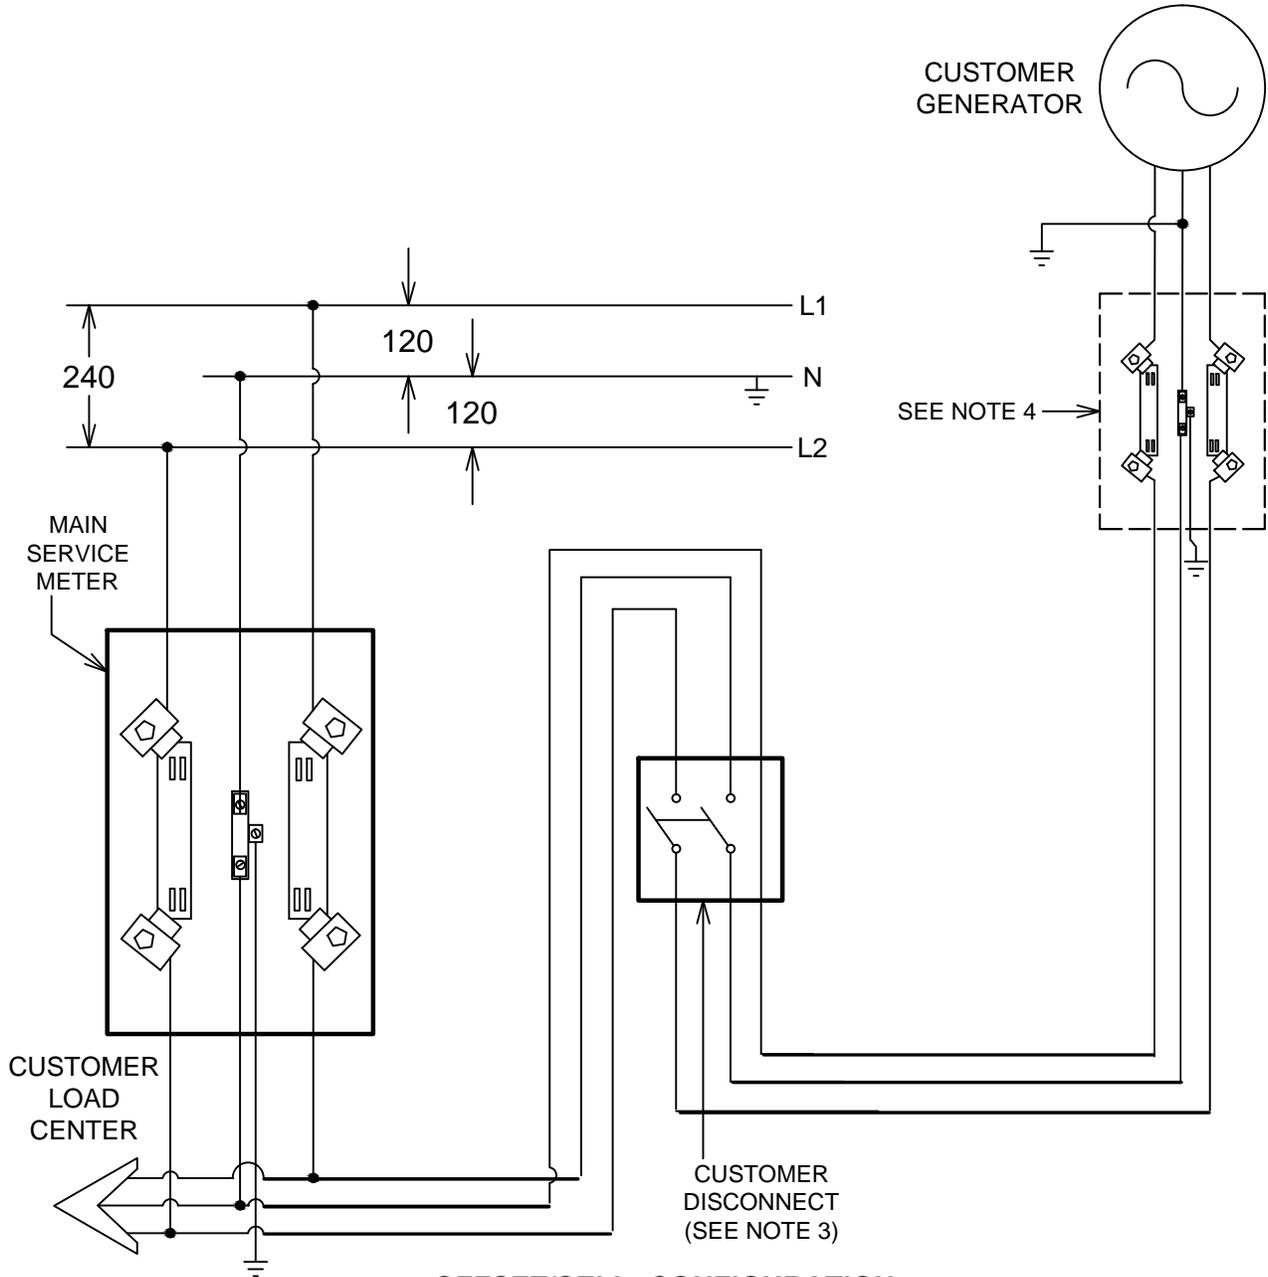

OFFSET/SELL -CONFIGURATION

NOTES:

1. CUSTOMER GENERATOR CAN BE SOLAR, WIND OR OTHER QUALIFYING SYSTEM.
2. ALL EQUIPMENT MUST BE UL APPROVED, MEET IEEE STANDARDS AND COMPANY SAFETY REQUIREMENTS. INSTALLATION MUST MEET COMPANY, NEC, AND LOCAL CODE REQUIREMENTS.
3. MAIN SERVICE METER SOCKET AND CUSTOMER DISCONNECT MUST BE MARKED WITH PERMANENT LABELS (SUPPLIED BY COMPANY).
4. IF REQUIRED, A NON-UTILITY METER SOCKET MAY BE INSTALLED BETWEEN THE GENERATOR AND THE DISCONNECT SWITCH. THE LOCATION OF THE NON-UTILITY METER SOCKET SHALL BE DETERMINED BY A COMPANY REPRESENTATIVE (THE PREFERRED LOCATION IS NOT ADJACENT TO THE MAIN SERVICE METER).

EFFECTIVE
DATE:
08-23-21

**DISTRIBUTION CONSTRUCTION STANDARD
DOMINION ENERGY SOUTH CAROLINA, INC.**