



Date of Inspection: 11/6/2023  
Facility: CPS FFCP Facility

### Annual Inspection Report for CCR Landfills

Reference: 40 CFR Section 257.84, *Inspection Requirements for CCR Landfills*

#### Owner Information


Name of Landfill: Chesterfield Power Station FFCP Management Facility  
Owner's Name: Virginia Electric and Power Company d.b.a. Dominion Energy  
State ID #: Solid Waste Permit #609  
Owner Contact: Kevin Bishoff - Construction Project Manager  
Landfill Location: Chester, VA

#### Engineer Information

Name and Virginia License Number: Donald Mayer 029879  
Firm Name: WSP USA Inc.  
Firm Address: 1100 Boulders Parkway, Suite 503, Richmond, VA 23225  
Telephone No.: 804-358-7900

#### Certification Statement

I certify that the inspection of the above listed CCR landfill was conducted in conformance with the requirements listed in 40 CFR 257.84, and with generally accepted good engineering practices.

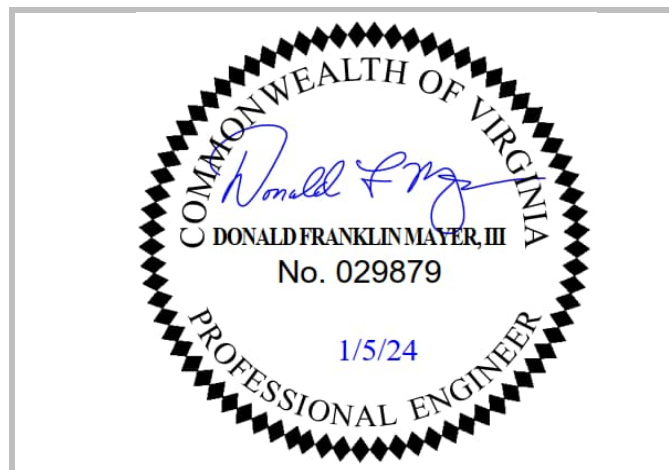

Engineer seal, signature and date

As used herein, the word certify shall mean an expression of the Engineer's professional opinion to the best of his or her information, knowledge and belief, and does not constitute a warranty or guarantee by the Engineer



Date of Inspection: 11/6/2023  
Facility: CPS FFCP Facility

Was a review performed of available information regarding the status of the CCR unit, including files in the operating record? 

Yes	No
X	

Was a visual inspection performed to identify signs of stress or malfunction of the CCR unit? 

X	
---	--

Identify any changes in the geometry of the structure since the previous annual inspection

Cell 1 filled with intermediate cover installed. Filling of Cell 2 ongoing. Stockpile relocation in preparation for construction of Cell 3 has been initiated.

Approximate volume of the CCR contained in the unit at the time of inspection

Approximately 1,033,031 cubic yards contained in Cell 1 and approximately 532,287 cubic yards contained in Cell 2 as of survey completed on 11/23/23.

Identify any appearances of an actual or potential structural weakness of the CCR unit, in addition to any existing conditions that are disrupting or have the potential to disrupt the operation and safety of the CCR unit

None observed.

Identify any other change(s) which may have affected the stability or operation of the CCR unit since the previous annual inspection.

None observed.

Additional comments

None.