



Annual Inspection Report for Existing CCR Surface Impoundment

Reference: 40 CFR Section 257.83, *Inspection Requirements for CCR Surface Impoundments*

Owner Information


Name of Dam: Chesterfield Power Station Dam
Owner's Name: Virginia Electric and Power Company d.b.a. Dominion Energy
State ID #: DCR Inventory # 041045, VPDES # VA0004146
Owner Contact: Jannina Gahagan - Environmental Compliance Manager
Dam Location: Chester, VA

Engineer Information

Name and Virginia License Number: Andrew North 053724
Firm Name: Golder Associates Inc.
Firm Address: 2108 W. Laburnum Ave, Suite 200, Richmond, VA 23227
Telephone No.: 804-358-7900

Certification Statement

I certify that the inspection of the above listed CCR surface impoundment was conducted in conformance with the requirements listed in 40 CFR 257.83, and with generally accepted good engineering practices.

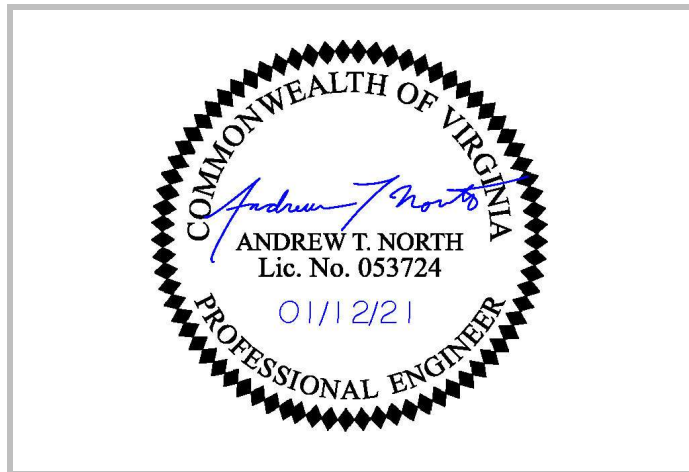

Engineer seal, signature and date

As used herein, the word certify shall mean an expression of the Engineer's professional opinion to the best of his or her information, knowledge and belief, and does not constitute a warranty or guarantee by the Engineer



Date of Inspection: 11/13/2020

Facility: Chesterfield Upper Pond

	Yes	No
Was a review performed of available information regarding the status of the CCR unit, including files in the operating record?	X	

Was a visual inspection performed (i) to identify signs of stress or malfunction of the CCR unit and appurtenant structures, and (ii) of all hydraulic structures underlying the base or passing through the dike of the CCR unit for structural integrity and safe and reliable operation?	X	
---	---	--

Identify any changes in the geometry of the impounding structure since the previous annual inspection.

In accordance with the Department of Conservation and Recreation (DCR) permit, effective October 25, 2019 through February 17, 2020, for Inventory Number 041045, three (3) riprap spillways have been constructed on the south side of the Upper Ash Pond and an emergency spillway has been constructed adjacent to the stormwater pond riser structure. As stated in the DCR Permit, the proposed modifications are to upgrade the spillway discharge capacity.

Verify the type, location, and condition of existing instrumentation (e.g. flow meter or staff gauge). Document the maximum recorded readings of each instrument since the previous annual inspection.

No instrumentation.

List the minimum, maximum, and present depth and elevation of impounded water and CCR since the previous annual inspection.

Water level in pond*:

Minimum Depth (ft)	0.0	Maximum Depth (ft)	5 +/-	Present Depth (ft)	3.5
Minimum Elev. (Ft)	25.0	Maximum Elev. (ft)	30.0	Present Elev. (ft)	28.5

*STORMWATER MANAGEMENT FACILITY

CCR level in Pond:

Minimum Depth (ft)	50.0	Maximum Depth (ft)	115.0	Present Depth (ft)	Varies*
Minimum Elev. (Ft)	40.0	Maximum Elev. (ft)	105.0	Present Elev. (ft)	Varies*

*CCR SURFACE TOPOGRAPHY VARIES BETWEEN MIN AND MAX ELEVATION

Maximum Storage Capacity: 9,017 Ac - Ft.

Present volume of the impounded water:	17	Ac - Ft.
Present volume of the impounded CCR:	6,891	Ac - Ft.
Present volume, total	6,908	Ac - Ft.



GOLDER

Date of Inspection: 11/13/2020

Facility: Chesterfield Upper Pond

Identify any appearances of an actual or potential structural weakness of the CCR unit or existing conditions that are disrupting or have the potential to disrupt the operation and safety of the CCR unit and appurtenant structures.

None observed.

Identify any changes that may have affected the stability or operation of the impounding structure since the previous annual inspection.

In accordance with the Department of Conservation and Recreation (DCR) permit, effective October 25, 2019 through February 17, 2020, for Inventory Number 041045, three (3) riprap spillways have been constructed on the south side of the Upper Ash Pond and an emergency spillway has been constructed adjacent to the stormwater pond riser structure. As stated in the DCR Permit, the proposed modifications are to upgrade the spillway discharge capacity. structure.

Additional comments

The Chesterfield Upper Ash Pond meets the definition of an existing surface impoundment under 40CFR 257.53 of the "Standards for the Disposal of Coal Combustion Residuals (CCR) in Landfills and Surface Impoundments". The Upper Ash Pond no longer receives CCRs and is stabilized with vegetation with the exception of a stormwater retention pond, located in the eastern portion of the pond, and other areas currently under construction.