



**Annual Inspection Report for Existing CCR Surface Impoundment**

Reference: 40 CFR Section 257.83, *Inspection Requirements for CCR Surface Impoundments*

**Owner Information**


Name of Dam: Possum Point Ash Pond ABC Dam  
Owner's Name: Virginia Electric and Power Company  
State ID #: DCR Inventory #153051  
Owner Contact: Jeff Marcell 703-441-3813  
Dam Location: Dumfries, Virginia

**Engineer Information**

Name and Virginia License Number: Daniel McGrath 040703  
Firm Name: Golder Associates Inc.  
Firm Address: 2108 W. Laburnum Ave, Suite 200, Richmond, VA 23227  
Telephone No.: 804-358-7900

**Certification Statement**

I certify that the inspection of the above listed CCR surface impoundment was conducted in conformance with the requirements listed in 40 CFR 257.83, and with generally accepted good engineering practices.

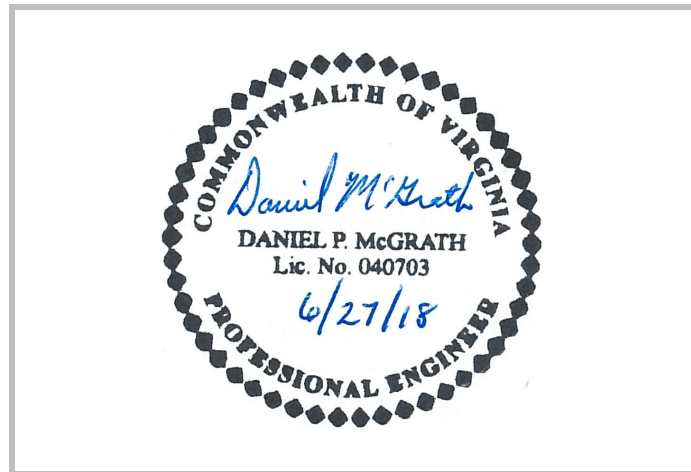

Engineer seal, signature and date

As used herein, the word certify shall mean an expression of the Engineer's professional opinion to the best of his or her information, knowledge and belief, and does not constitute a warranty or guarantee by the Engineer



Date of Inspection: 6/22/2018

Facility: Possum Point Pond ABC

	Yes	No
Was a review performed of available information regarding the status of the CCR unit, including files in the operating record?	X	

Was a visual inspection performed (i) to identify signs of stress or malfunction of the CCR unit and appurtenant structures, and (ii) of all hydraulic structures underlying the base or passing through the dike of the CCR unit for structural integrity and safe and reliable operation?	X	
---	---	--

Identify any changes in the geometry of the impounding structure since the previous annual inspection.

CCR has been removed except for a small area in Pond A. A small sump remains in the north (Pond C) area from which accumulated stormwater is pumped to Pond D.

Verify the type, location, and condition of existing instrumentation (e.g. flow meter or staff gauge). Document the maximum recorded readings of each instrument since the previous annual inspection.

No flow or water level instrumentation.

List the minimum, maximum, and present depth and elevation of impounded water and CCR since the previous annual inspection.

Minimum Depth (ft)	2.0	Maximum Depth (ft)	5.0	Present Depth (ft)	2.0
Minimum Elev. (Ft)	-3.0	Maximum Elev. (ft)	0.0	Present Elev. (ft)	-3.0

**(WATER ONLY, NO CCR OBSERVED)**

Present Storage Capacity: 117.3 Ac - Ft.

Present volume of the impounded water and CCR: 1.0 Ac - Ft.

Identify any appearances of an actual or potential structural weakness of the CCR unit or existing conditions that are disrupting or have the potential to disrupt the operation and safety of the CCR unit and appurtenant structures.

None observed.

Identify any changes that may have affected the stability or operation of the impounding structure since the previous annual inspection.

CCR has been removed except for a small area in Pond A; soil berms are left in place.



**GOLDER**

Date of Inspection: 6/22/2018

Facility: Possum Point Pond ABC

Additional comments

Ponds ABC meet the definition of an inactive surface impoundment under 40CFR 257.53 of the "Standards for the Disposal of Coal Combustion Residuals (CCR) in Landfills and Surface Impoundments". Ponds ABC no longer receive CCRs and at the time of my visit had a small volume of standing stormwater.