



Date of Inspection: 12/20/2022
 Facility: Class III Landfill

Annual Inspection Report for CCR Landfills

Reference: 40 CFR Section 257.84, *Inspection Requirements for CCR Landfills*

Owner Information

Name of Landfill: Williams Steam Operations Hwy 52 Class III Ash Landfill
 Owner's Name: Dominion Energy South Carolina d.b.a. Dominion Energy
 State ID #: #LF3-00001
 Owner Contact: Mark Valerio, Environmental Compliance Coordinator
 Landfill Location: Goose Creek, SC

Engineer Information


Name and South Carolina License Number: Nakia W. Addison, PE 31497
 Firm Name: TRC Environmental Corp.
 Firm Address: 50 International Drive, Suite 150, Greenville, SC 29615-3712
 Telephone No.: 864-275-1285

Certification Statement

I certify that the inspection of the above listed CCR landfill was conducted in conformance with the requirements listed in 40 CFR 257.84, and with generally accepted good engineering practices.



Engineer seal, signature and date

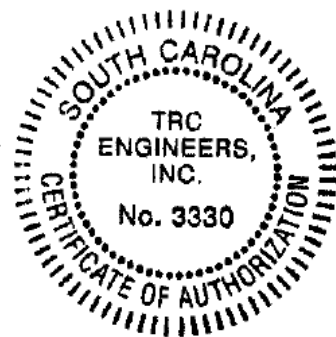

Firm Certificate of Authorization

As used herein, the word certify shall mean an expression of the Engineer's professional opinion to the best of his or her information, knowledge and belief, and does not constitute a warranty or guarantee by the Engineer



Date of Inspection: 12/20/2022
Facility: Class III Landfill

Was a review performed of available information regarding the status of the CCR unit, including files in the operating record?

Yes	No
X	

Was a visual inspection performed to identify signs of stress or malfunction of the CCR unit?

X	
---	--

Identify any changes in the geometry of the structure since the previous annual inspection

Fill continues in the active working area of the landfill which is on the western end. The active working area is graded to to maximize the flow-length of stormwater runoff to the primary drop inlet located at the southeast corner. The non-working area of the top surface slopes easterly and has a vegetative cover. Except for the east side slope of the current active face, vegetative cover is placed over all side slopes to minimize erosion and reduce the area exposed to precipitation. Vegetative cover will be placed on the east side slope along with the top surface upon completion of grading activities.

Approximate volume of the CCR contained in the unit at the time of inspection

1,062,133 cubic yards.

Identify any appearances of an actual or potential structural weakness of the CCR unit, in addition to any existing conditions that are disrupting or have the potential to disrupt the operation and safety of the CCR unit

None observed.

Identify any other change(s) which may have affected the stability or operation of the CCR unit since the previous annual inspection.

No other changes observed since previous annual inspection.

Additional comments

None.