


CUNNINGHAM - DOOMS 500 KILOVOLT

ELECTRIC TRANSMISSION IMPROVEMENT PROJECT

MATERIAL
COMPARISON
SIMULATION




TO BE REPLACED

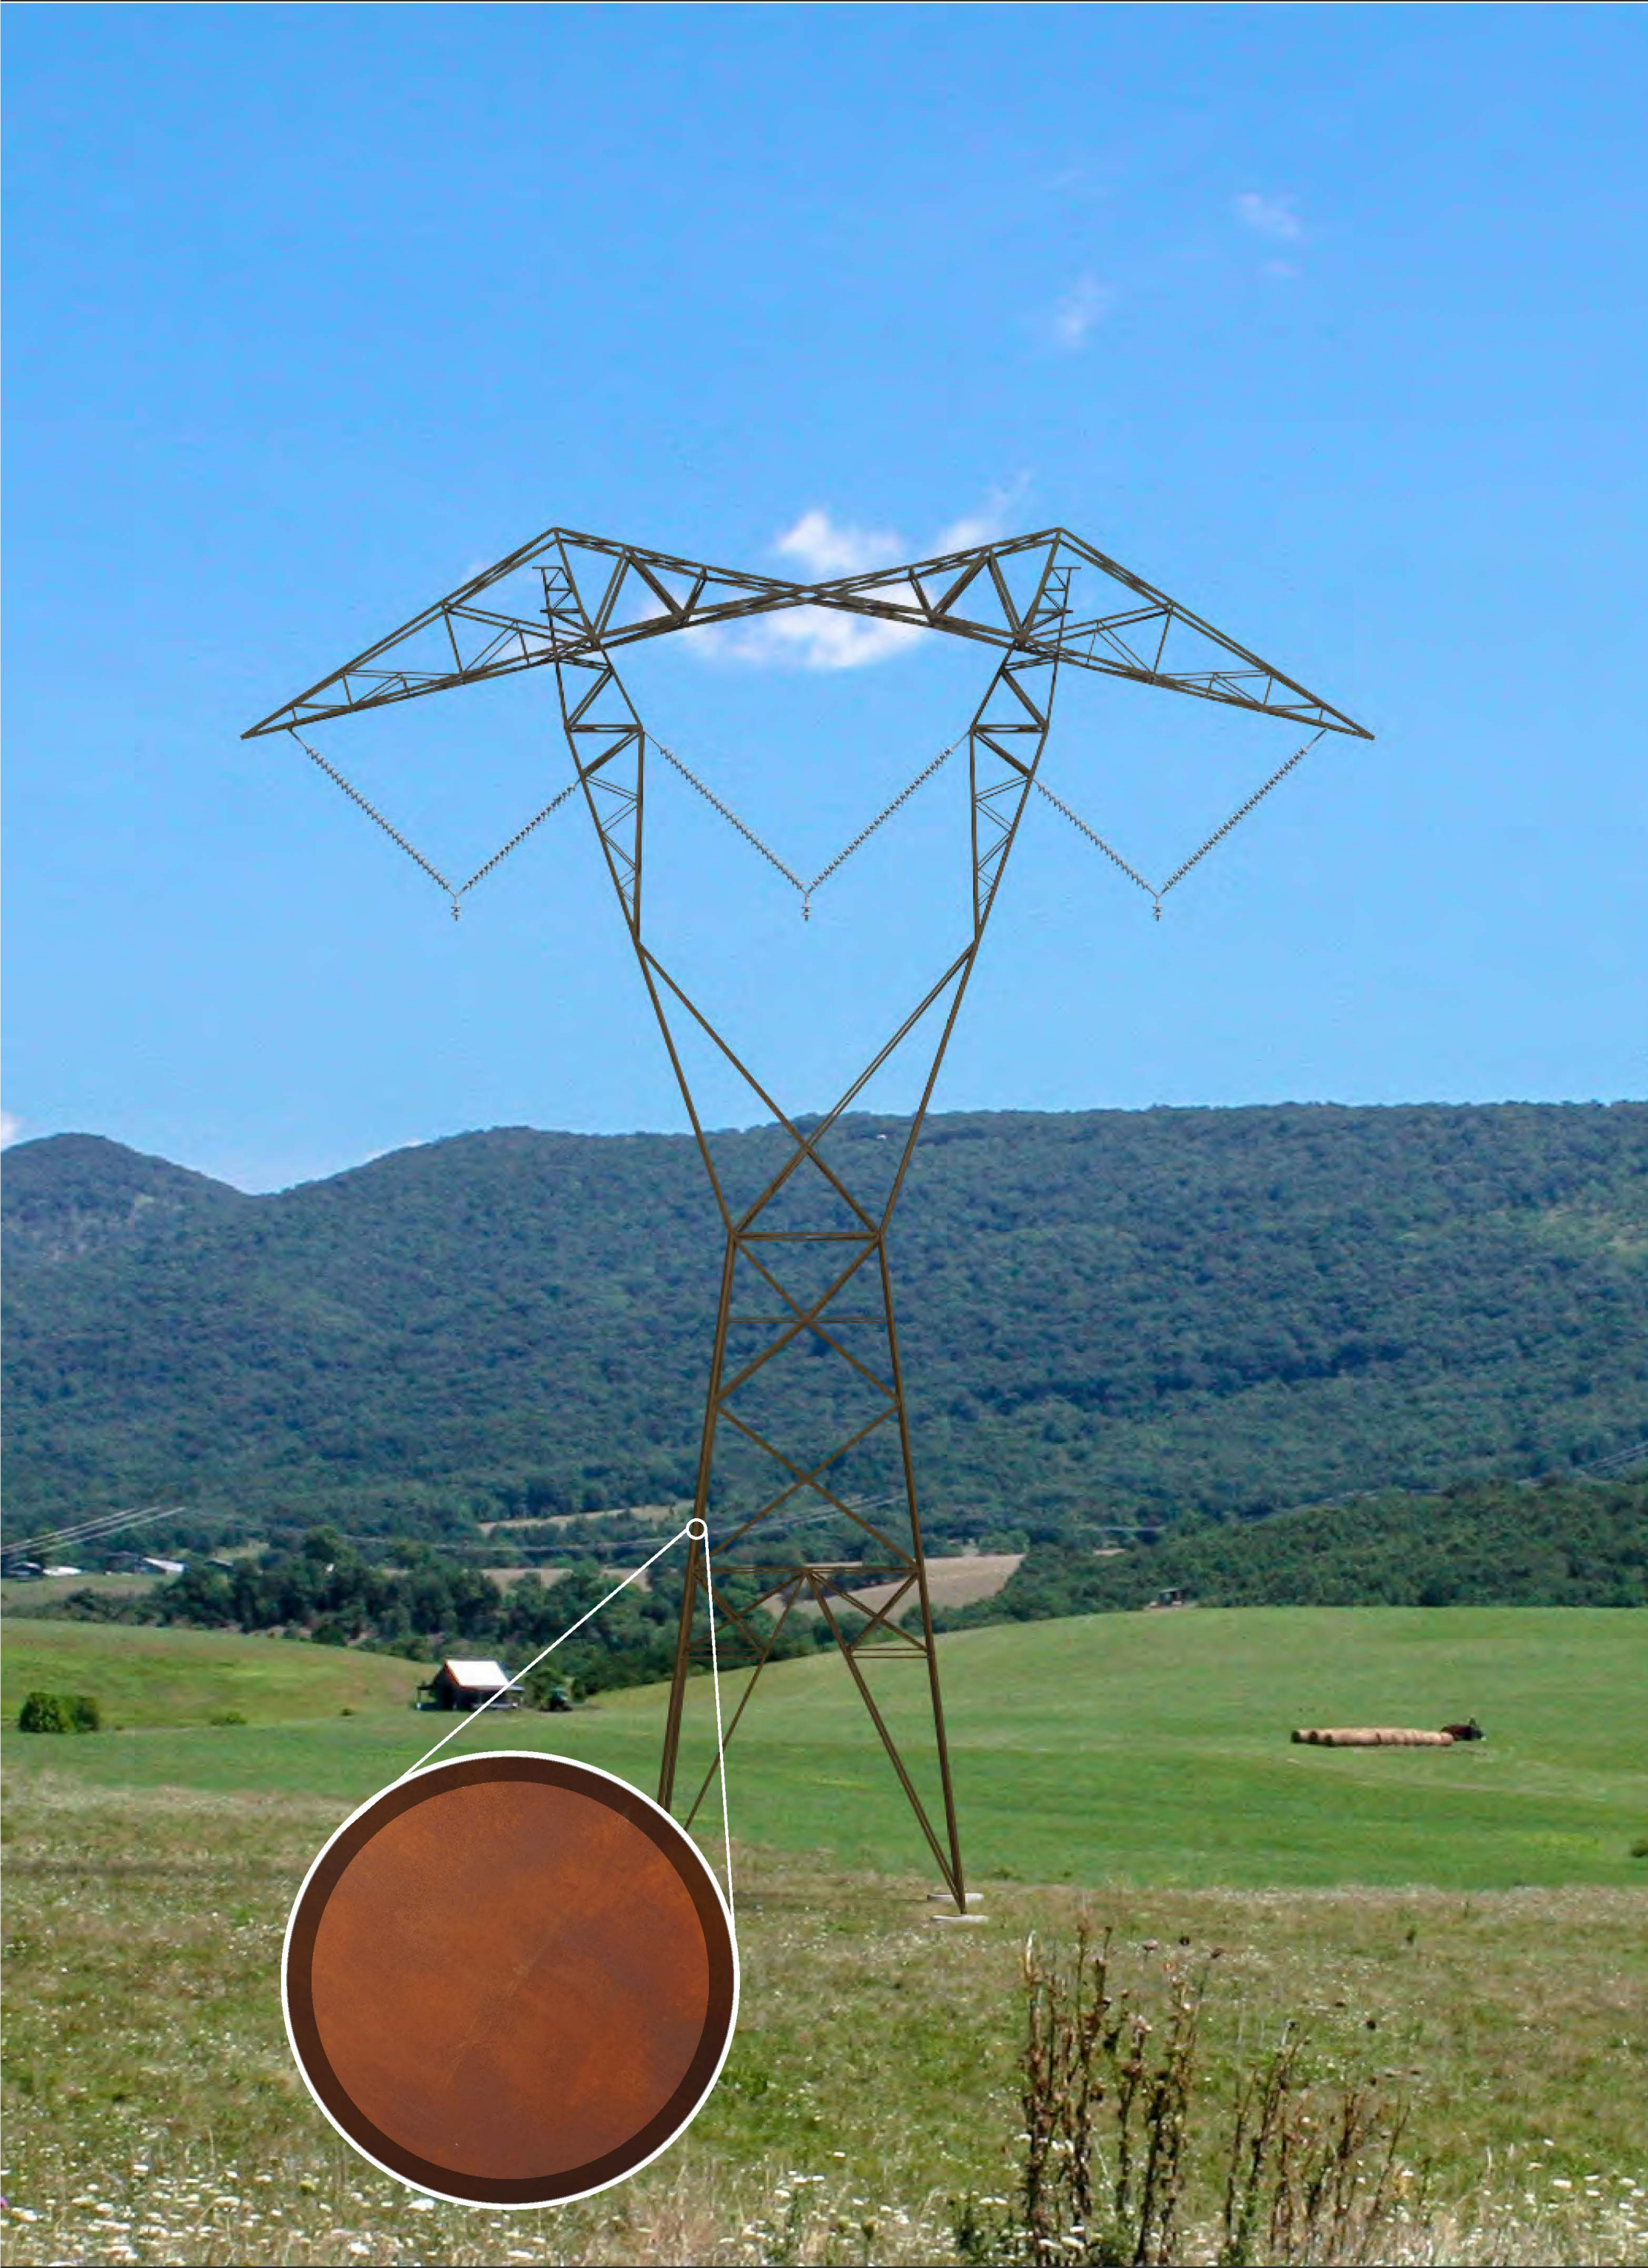


EXISTING WEATHERING STEEL LATTICE

APPROVED MATERIAL

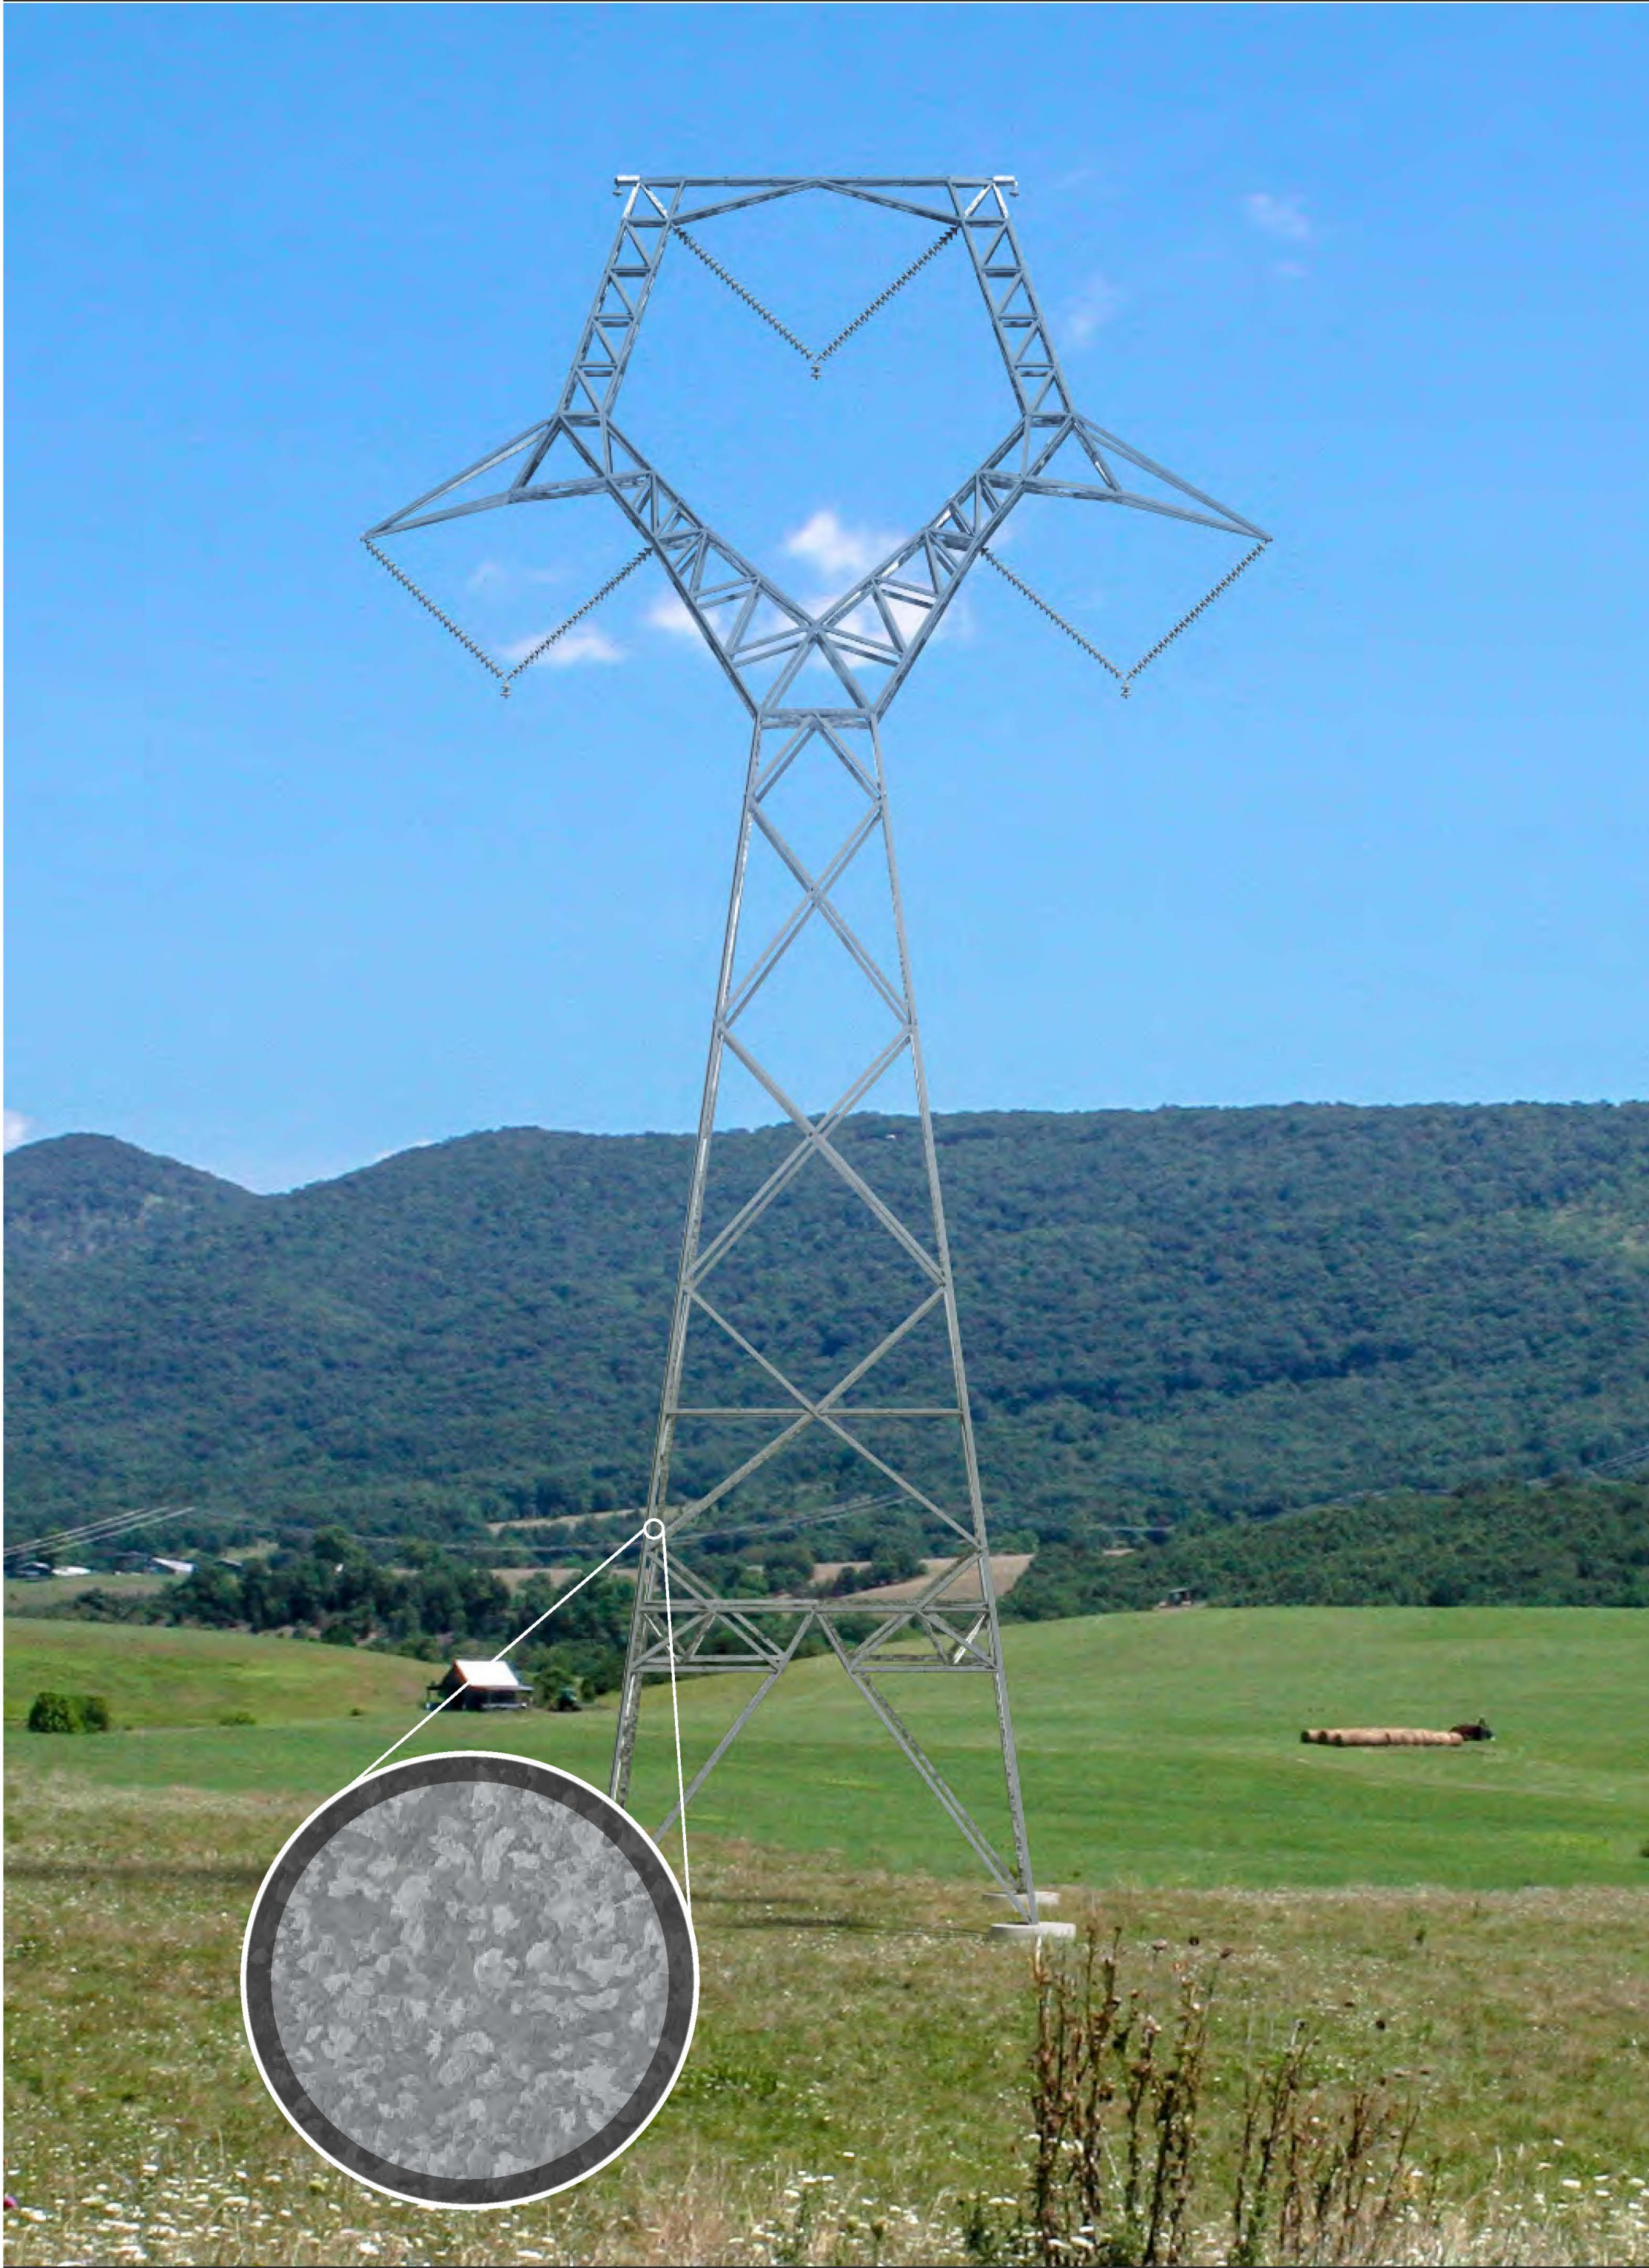

PRE-DULLED CHEMICALLY TREATED GALVANIZED STEEL LATTICE

ORIGINALLY PRESENTED MATERIAL

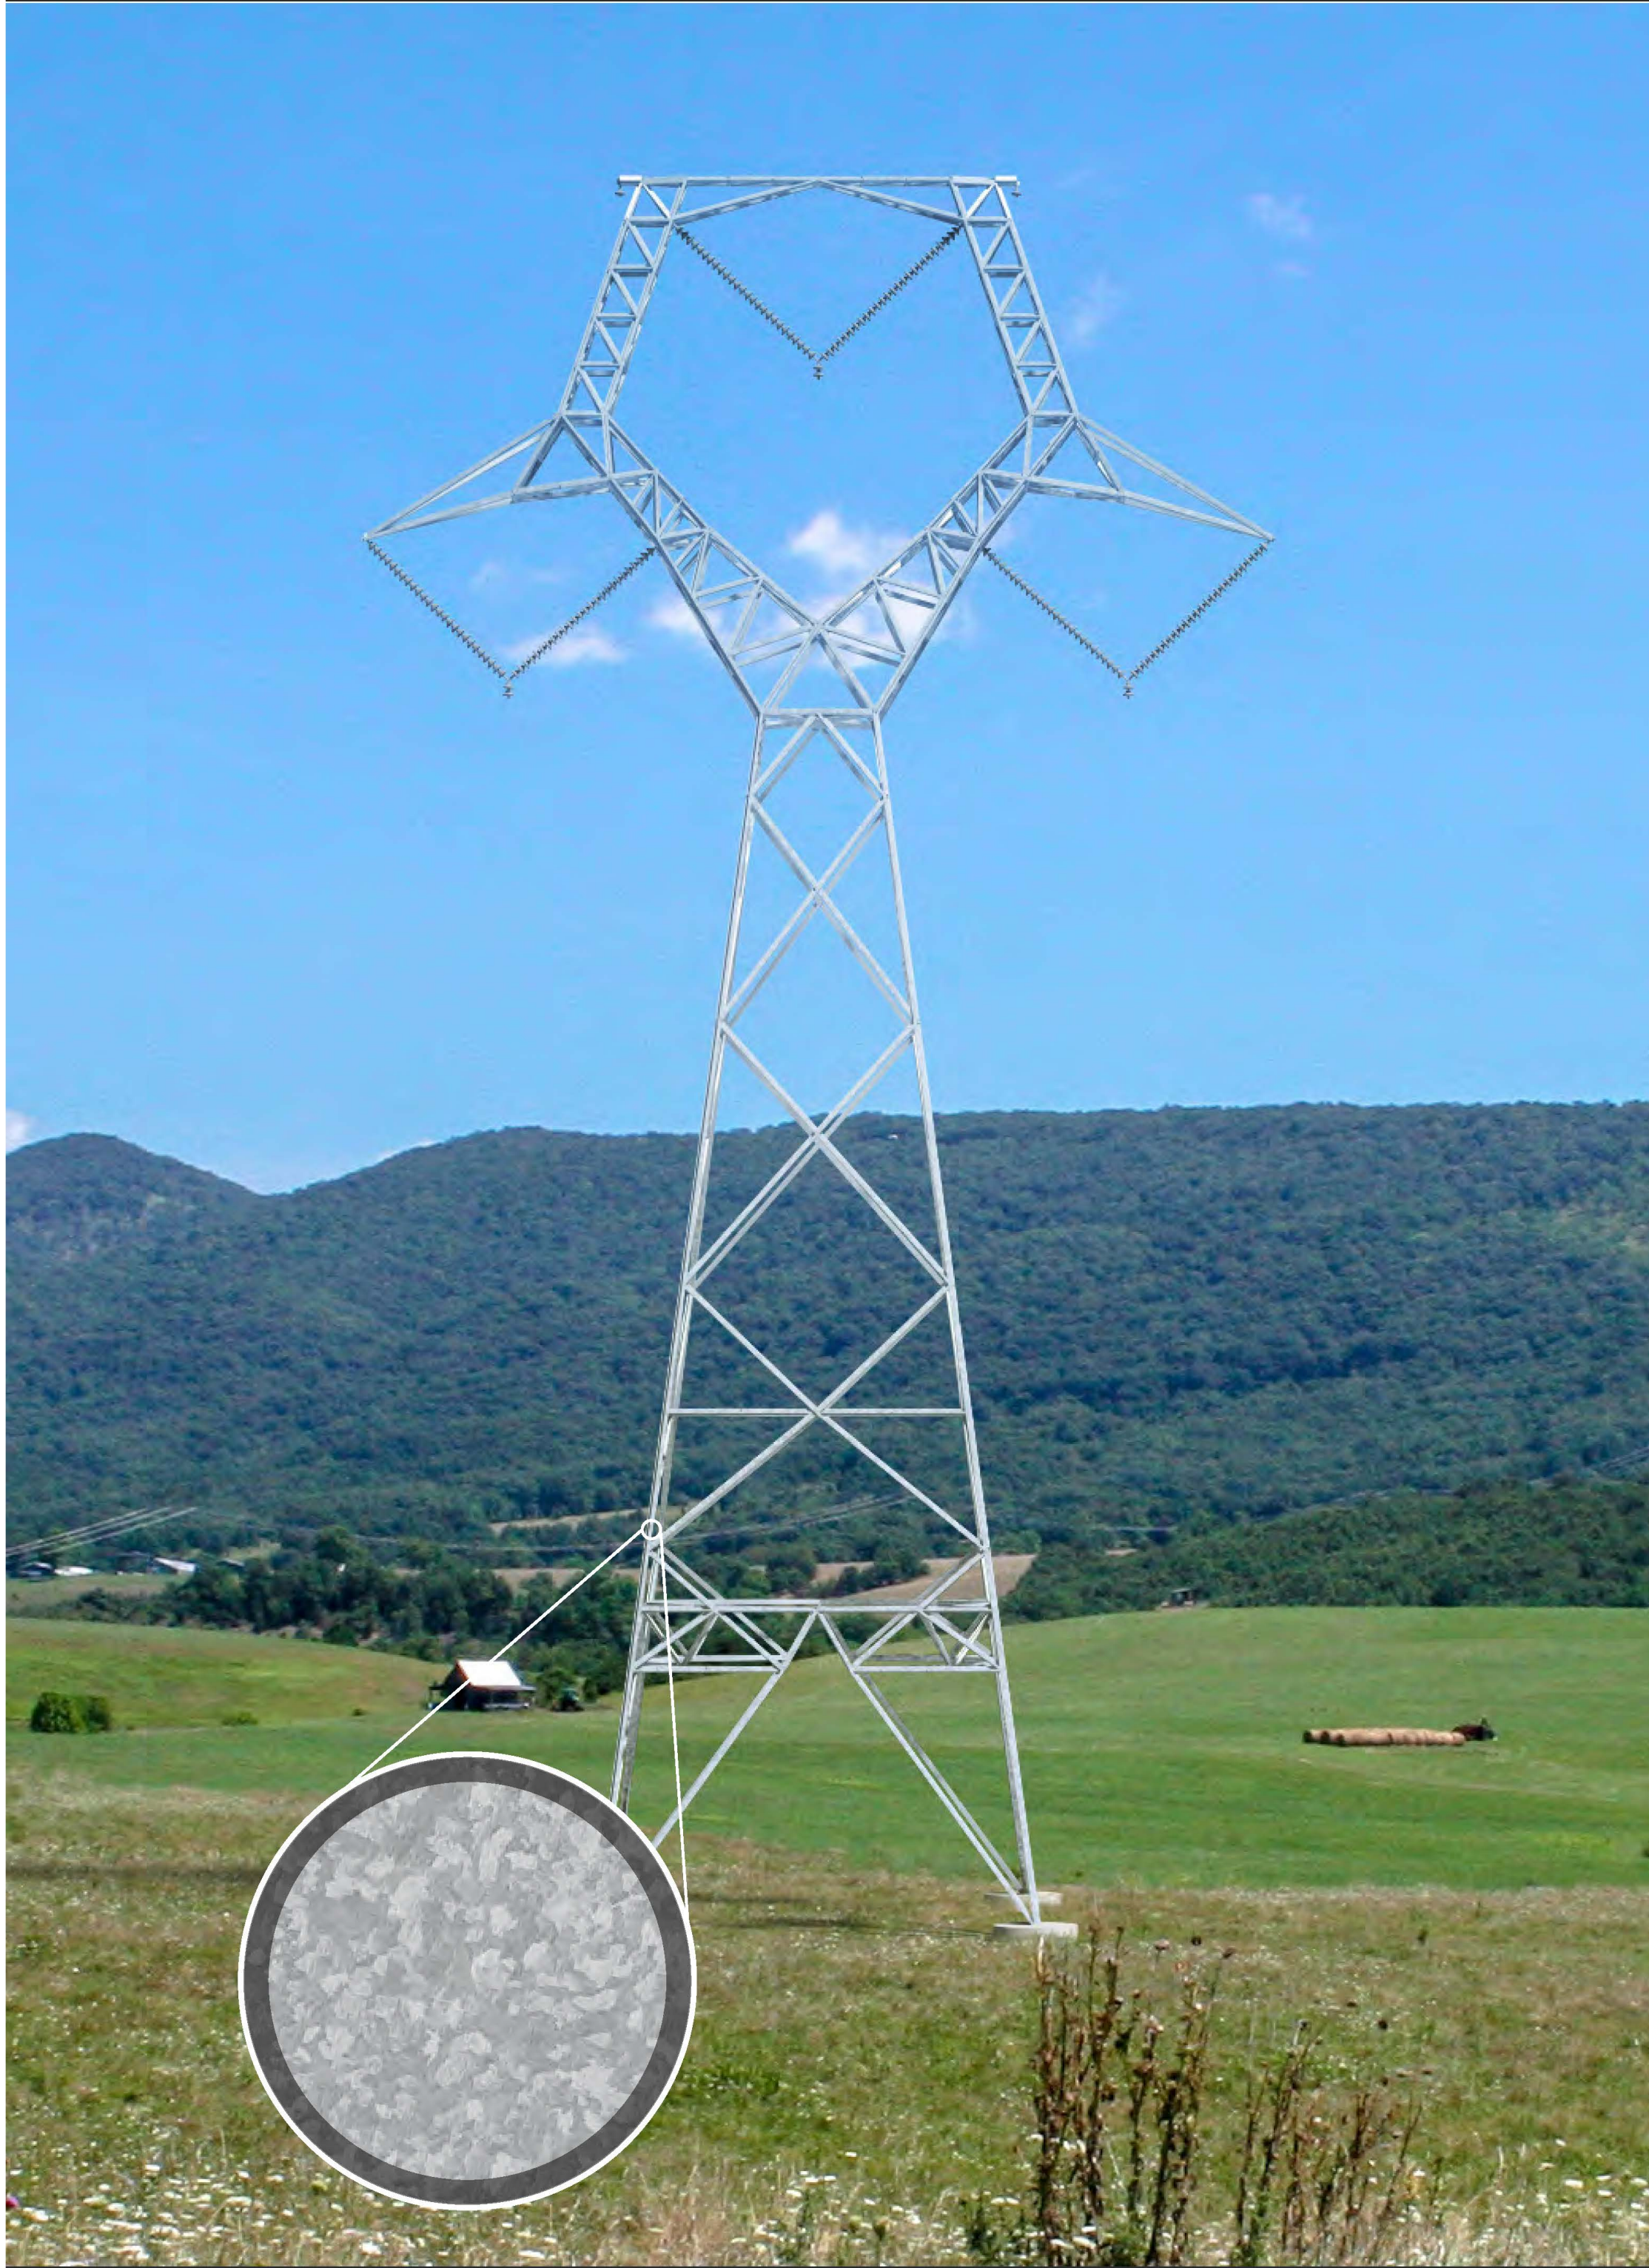

NEW GALVANIZED STEEL LATTICE

THE FINISHED COLORS DEPICTED ARE FOR REPRESENTATION ONLY.