


# Overhead Routes Studied, But Rejected

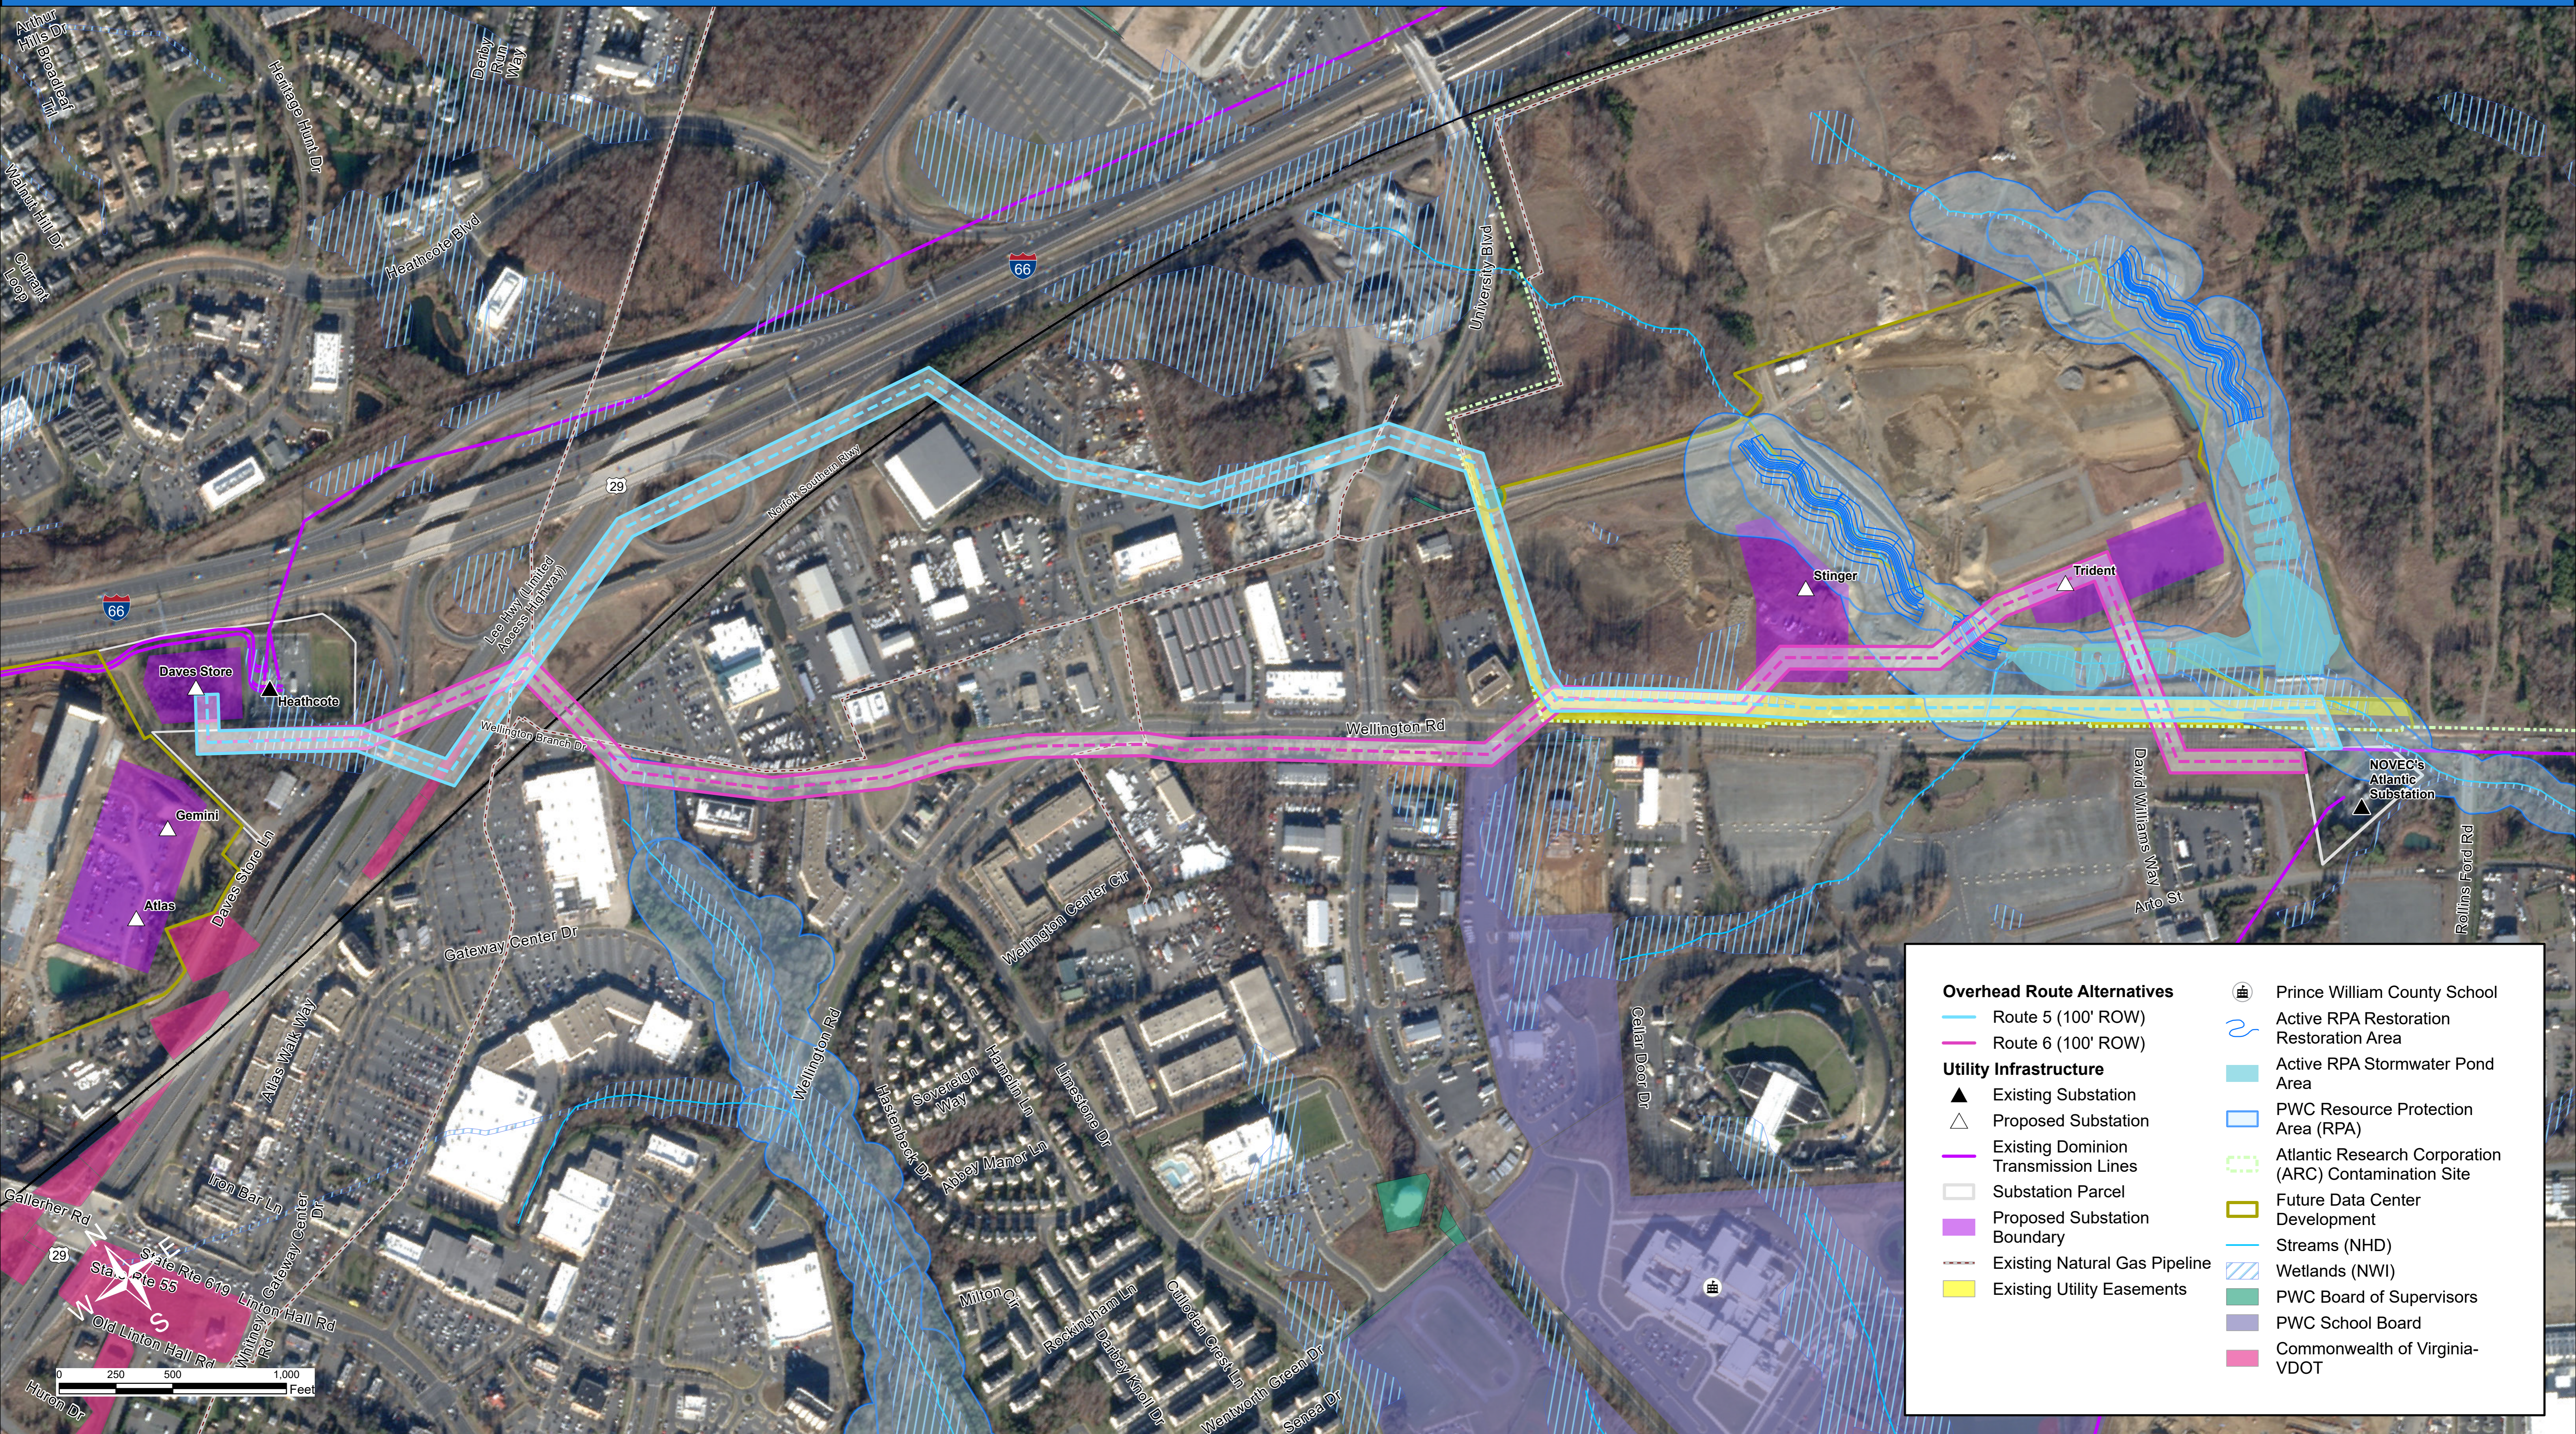

<b>Overhead Route Alternatives</b>	Prince William County School
Route 5 (100' ROW)	Active RPA Restoration
Route 6 (100' ROW)	Active RPA Stormwater Pond Area
<b>Utility Infrastructure</b>	PWC Resource Protection Area (RPA)
Existing Substation	Atlantic Research Corporation (ARC) Contamination Site
Proposed Substation	Future Data Center Development
Existing Dominion Transmission Lines	Streams (NHD)
Substation Parcel	Wetlands (NW1)
Proposed Substation Boundary	PWC Board of Supervisors
Existing Natural Gas Pipeline	PWC School Board
Existing Utility Easements	Commonwealth of Virginia-VDOT

# Daves Store Substation and 230 kV Transmission Line Project