

**Selected Corridor
Jasper - Okatie 230 kV #2**

**Existing
Jasper
Substation**

**Existing
Okatie
Substation**

**Existing
Dominion Energy
Transmission Line**


**Selected Corridor
Okatie - Riverport 230 kV**

**Existing
Hardeeville
Substation**

**Proposed
Riverport
Substation**

Study Area

1. Alternate route corridors are shown at a width of 400' for study purposes only. The actual right-of-way will vary between 100'-150' wide.
2. The actual right-of-way will be located within the 400' wide route corridor, unless constraints discovered during line surveying make it necessary to locate all or portions of the actual right-of-way outside the route corridor.

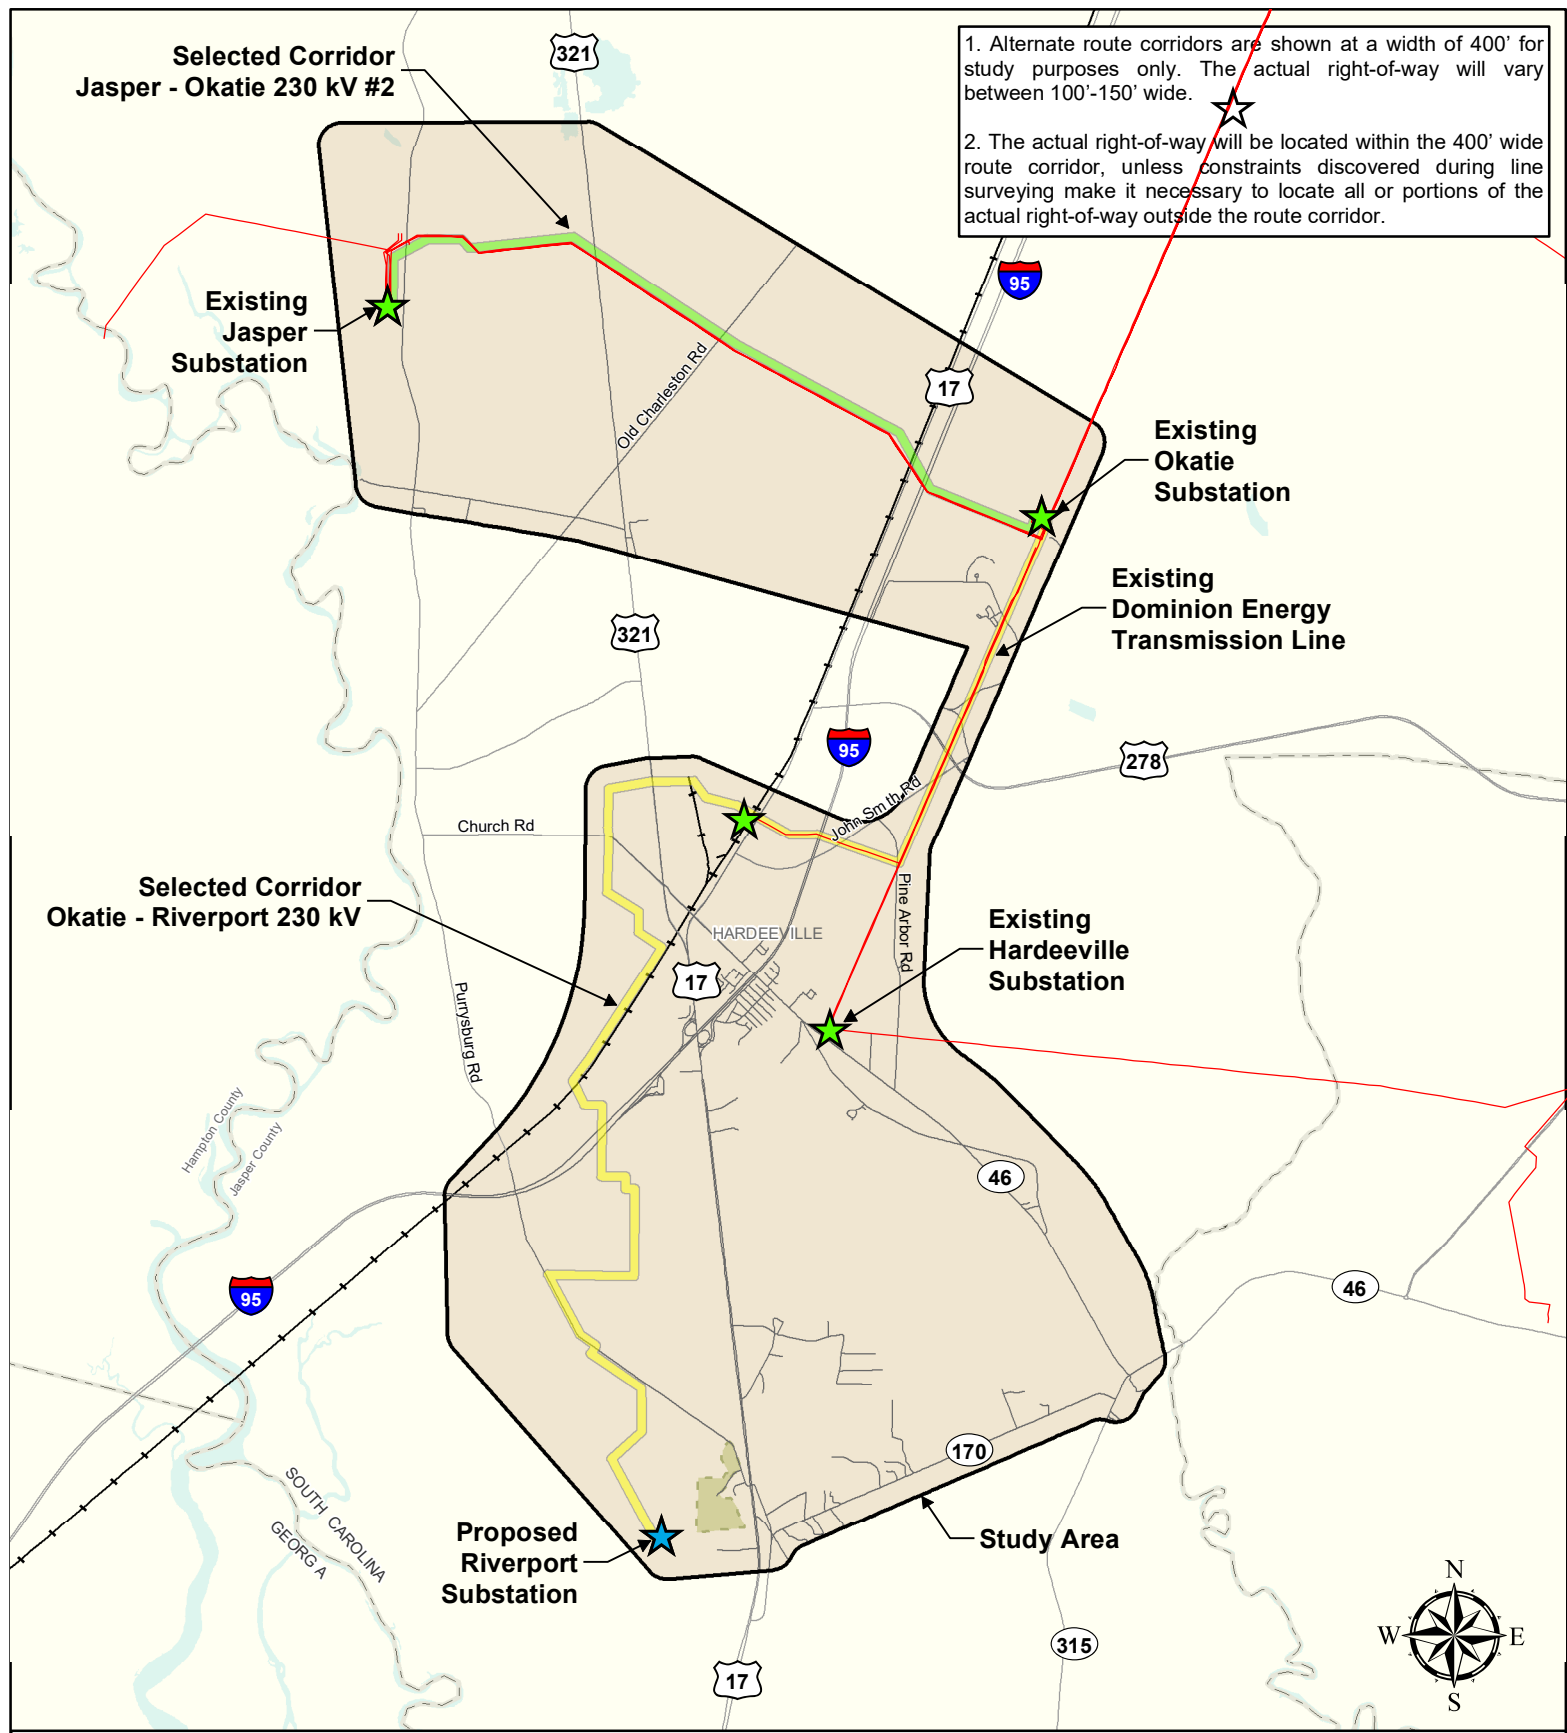

- Existing Dominion Energy Substation
- Proposed Riverport Substation
- Selected Corridor Jasper - Okatie 230 kV #2
- Selected Corridor Okatie - Riverport 230 kV
- Study Area Boundary
- Dominion Energy Transmission Line
- Railroad
- Road
- County Line

SELECTED ROUTE CORRIDOR

**For the
Jasper - Okatie 230 kV #2
and the
Okatie - Riverport 230 kV
Jasper County, South Carolina**

