


Study Area and Routing Constraints

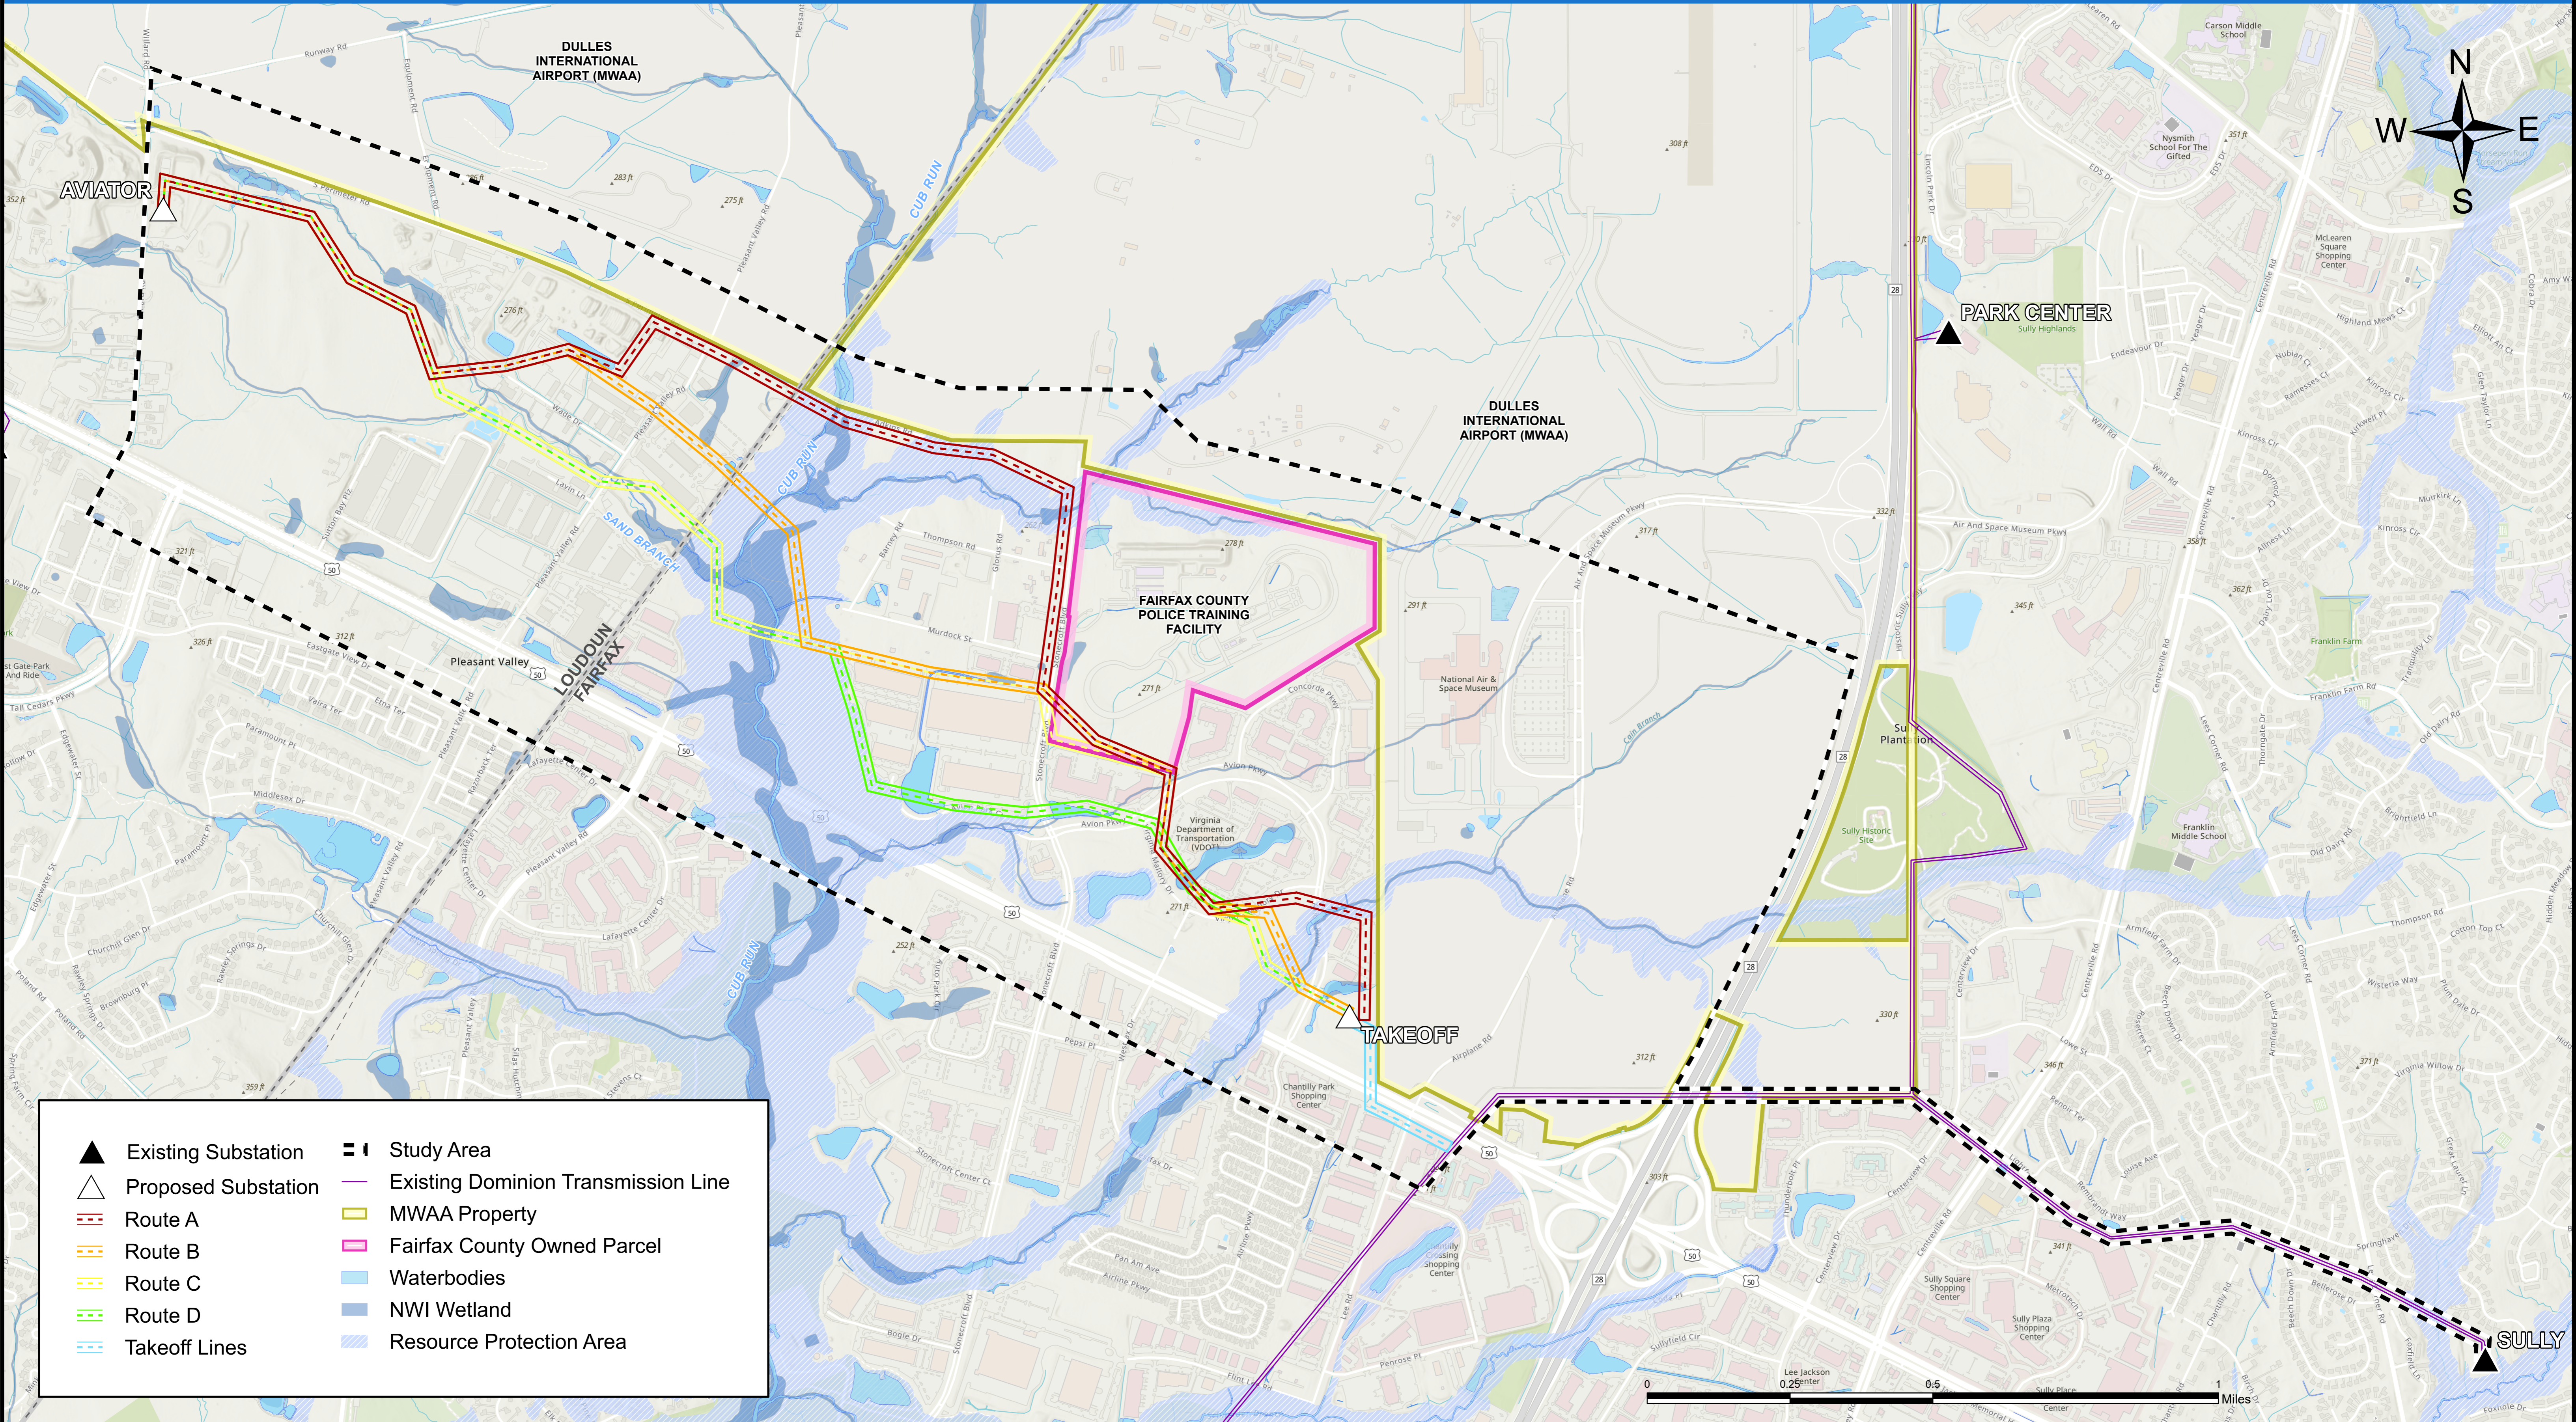

Takeoff 230 kV Line Loop and Takeoff Substation, 230 kV Aviator-Takeoff Lines, and Reconductor and Partial Rebuild of Line #265