

Staunton-Craigsville 115 kV Electric Transmission Rebuild Project

Augusta County, Virginia

At Dominion Energy, we are committed to providing safe, reliable, and affordable electricity to our neighbors. A 14.6-mile section of electric transmission line between our Staunton and Craigsville substations is at the end of its service life and needs to be rebuilt to maintain reliability for our customers.


Overview: The 115 kilovolt (kV) transmission line was built in 1925 primarily using galvanized steel lattice structures. We plan to rebuild the line primarily using brown weathering-steel poles.

Anticipated Schedule	
Q2 2021 – Q1 2022	Permitting activities, preliminary studies, stakeholder outreach
May 2021	Announce project to public
June 2022	Hold construction informational meeting
July 2022	Begin construction
Spring 2025	Complete construction
End of 2025	Complete restoration



Staunton-Craigsville 115 kV Electric Transmission Rebuild Project

Augusta County, Virginia

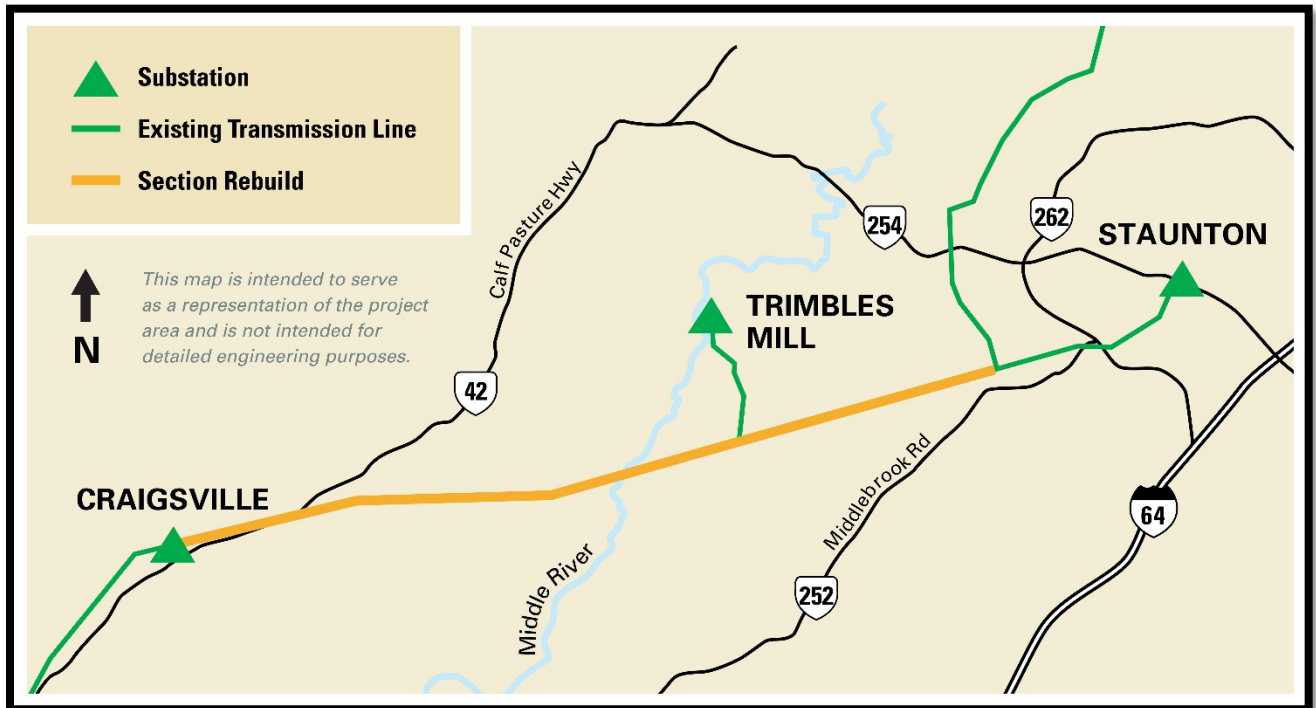

For more information about this project, please visit our website at DominionEnergy.com/staunton-craigsville. You may also contact us by sending an email to powerline@dominionenergy.com or calling 888-291-0190.

