

# BUY ALL / SELL ALL WIRING DIAGRAM

BY JAL


DATE 03-20-19

REV. 1

19.06-03

REV. 1 (03/20/19) - CHANGED SCE&G TO COMPANY; UPDATED NOTES

## BUY ALL / SELL ALL (CONFIGURATION #4)

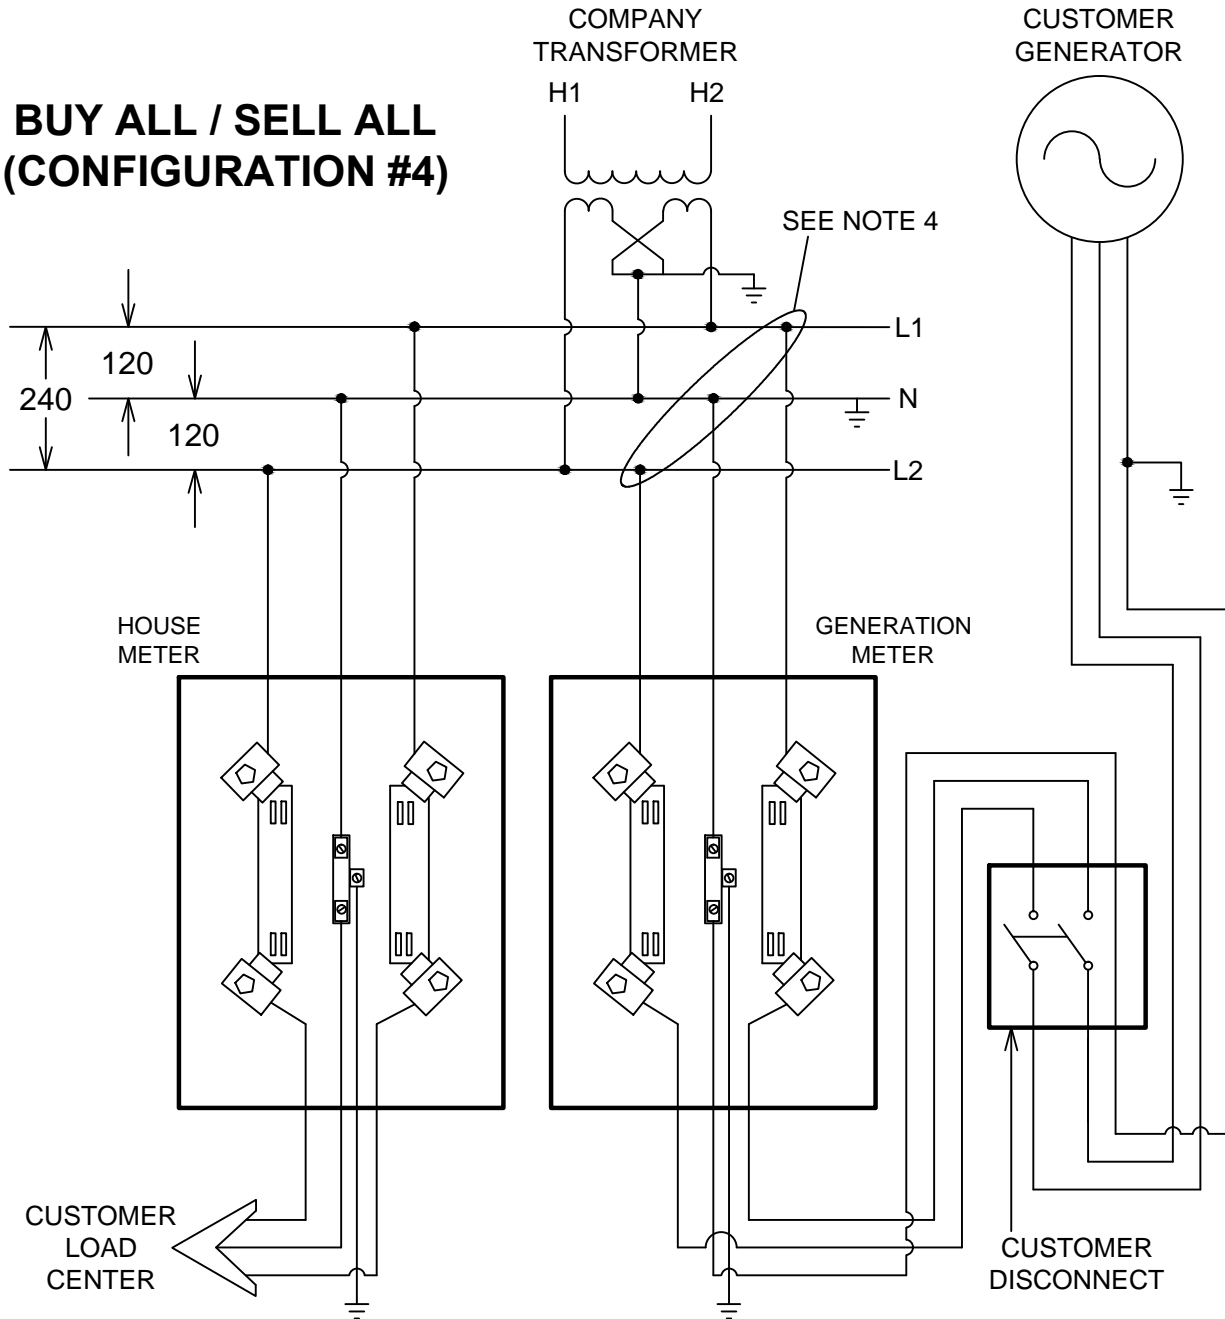

**NOTES:**

1. CUSTOMER GENERATOR CAN BE SOLAR, WIND OR OTHER QUALIFYING SYSTEM.
2. ALL EQUIPMENT MUST BE UL APPROVED, MEET IEEE STANDARDS AND COMPANY SAFETY REQUIREMENTS. INSTALLATION MUST MEET COMPANY, NEC, AND LOCAL CODE REQUIREMENTS.
3. GENERATION METER SOCKET AND DISCONNECT SWITCH MUST BE MARKED WITH PERMANENT LABELS (SUPPLIED BY COMPANY). STOCK CODE 080.7960.0380 (WARNING LABEL); STOCK CODE 080.7960.0376 (BUY ALL / SELL ALL LABEL).
4. UTILITY SIDE CONNECTIONS CANNOT BE MADE IN METER SOCKET; GANGED METER SOCKET IS ACCEPTABLE.

**EFFECTIVE DATE:**  
04-29-19

**DISTRIBUTION CONSTRUCTION STANDARD  
DOMINION ENERGY SOUTH CAROLINA, INC.**